

WATER TAPPING PERMIT
 issued by
The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0174 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by J. E. McLaughlin
 water distribution dept. finance director

Name _____ Size of tap 1" Date 7-31-97 Street and No. 720 Tyler

Old Tap No. 2277 New Tap No. 9728 Size and Kind of Main 8" C-900

Location of Main 6' East of East Curb Depth of Main 5'

Distance from Hydrant/Valve 233' North of Hyd 39 Distance to Curb Stop from Corp. 9'

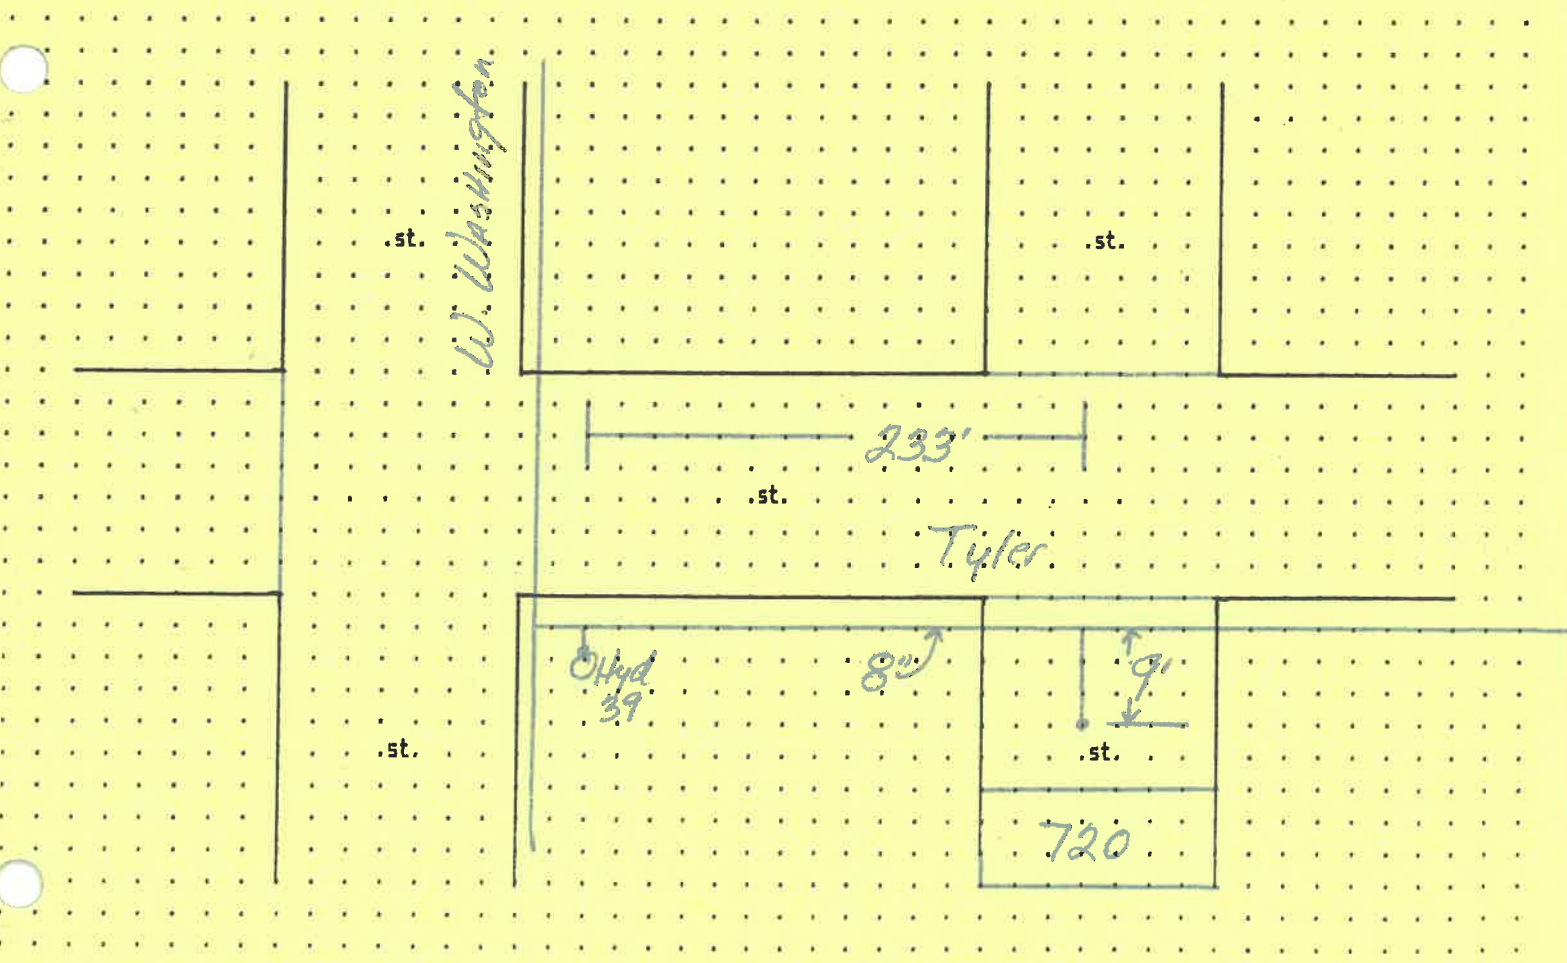

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0174 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by *Jeffrey C. McLaughlin* _____

water distribution dept.

finance director

Name _____ Size of tap *1"* Date *7-31-97* Street and No. *720 Tyler*

Old Tap No. *2277* New Tap No. *9728* Size and Kind of Main *8" C-900*

Location of Main *6' EAST OF EAST CURB* Depth of Main *5'*

Distance from Hydrant/Valve *233' North of Hyd 39* Distance to Curb Stop from Corp. *9'*

W. Washington

.st.

.st.

233'

.st.

Tyler

Hyd 39

8"

9'

.st.

.st.

720