

**WATER TAPPING PERMIT**  
issued by  
**The Napoleon Water Distribution Department**  
255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0175 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_).00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ " Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_

Date completed \_\_\_\_\_ Approved by Alley R. Mantel \_\_\_\_\_

water distribution dept.


finance director

Name \_\_\_\_\_ Size of tap 1" Date 7-31-99 Street and No. 722 Tyler

Old Tap No. 2275 New Tap No. 9729 Size and Kind of Main 8" C900

Location of Main 6' East of East Curb Depth of Main 5'

Distance from Hydrant/Valve 233'-6" North of Hyd<sup>39</sup> Distance to Curb Stop from Corp. 9'

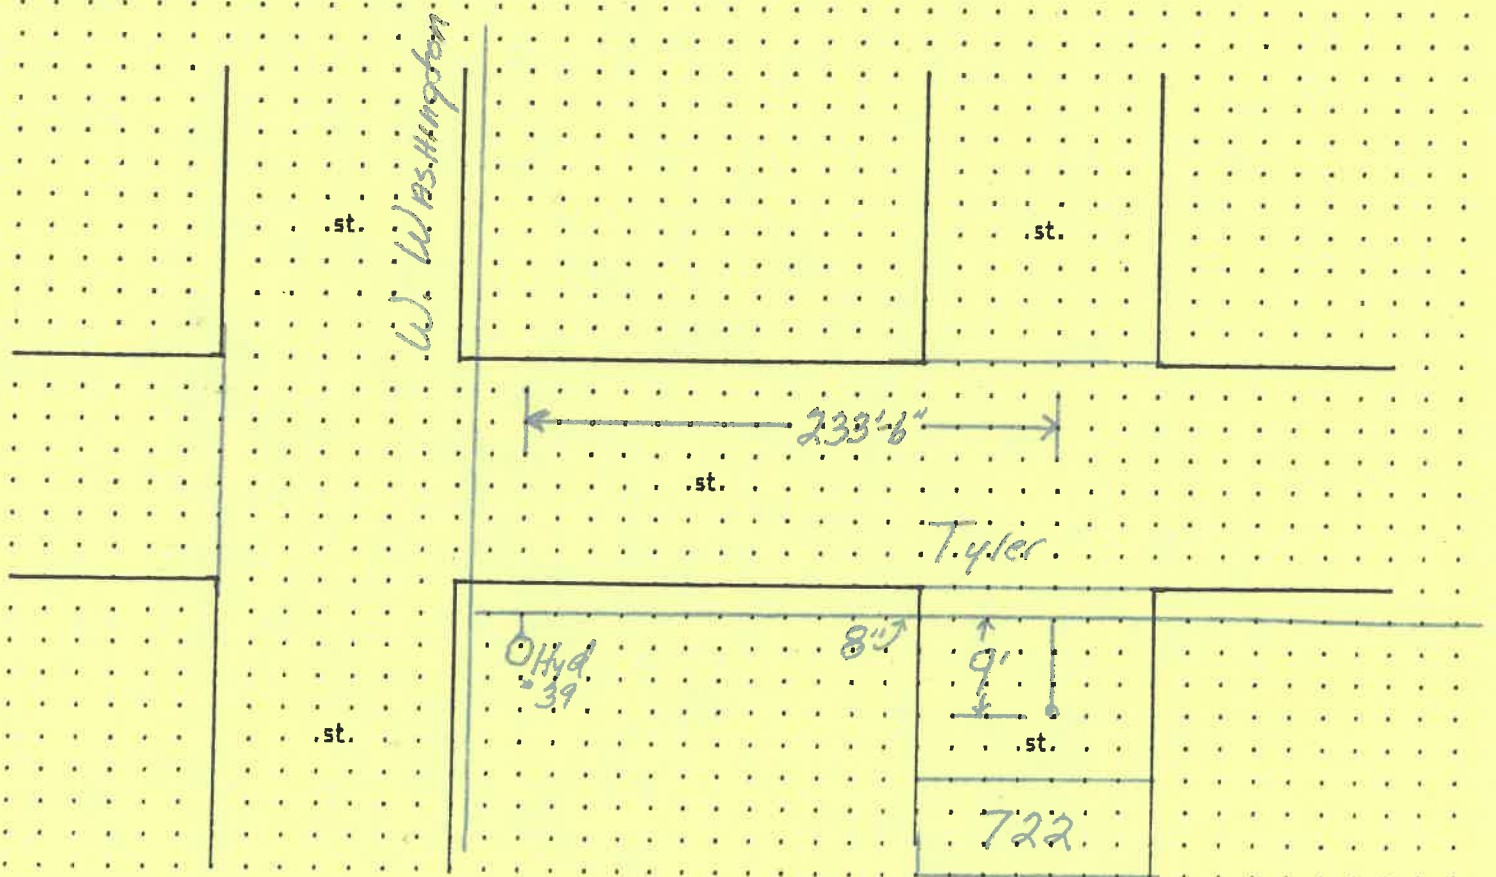

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W-0175 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_) .00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ " Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_

Date completed \_\_\_\_\_ Approved by Henry E. Mantel water distribution dept. \_\_\_\_\_ finance director

Name \_\_\_\_\_ Size of tap 1" Date 7-31-99 Street and No. 722 Tyler

Old Tap No. 2275 New Tap No. 9729 Size and Kind of Main 8" C-900

Location of Main 6' EAST OF EAST CURB Depth of Main 5'

Distance from Hydrant/Valve 233'-6" North of Hyd<sup>39</sup> Distance to Curb Stop from Corp. 9'

