

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0209 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_).00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ \* Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_


Date completed \_\_\_\_\_ Approved by Jeffrey E. Mantel water distribution dept. \_\_\_\_\_ finance director

Name Saraholtz (old batch plant) Size of tap 2" Date 8-21-97 Street and No. 302 E. Washington

Old Tap No. 3333 New Tap No. 9754 Size and Kind of Main 6" CIP

Location of Main underneath West curb Depth of Main 4 1/2'

Distance from Hydrant/Valve 277' North - F Hydrant 210 Distance to Curb Stop from Corp. 33'

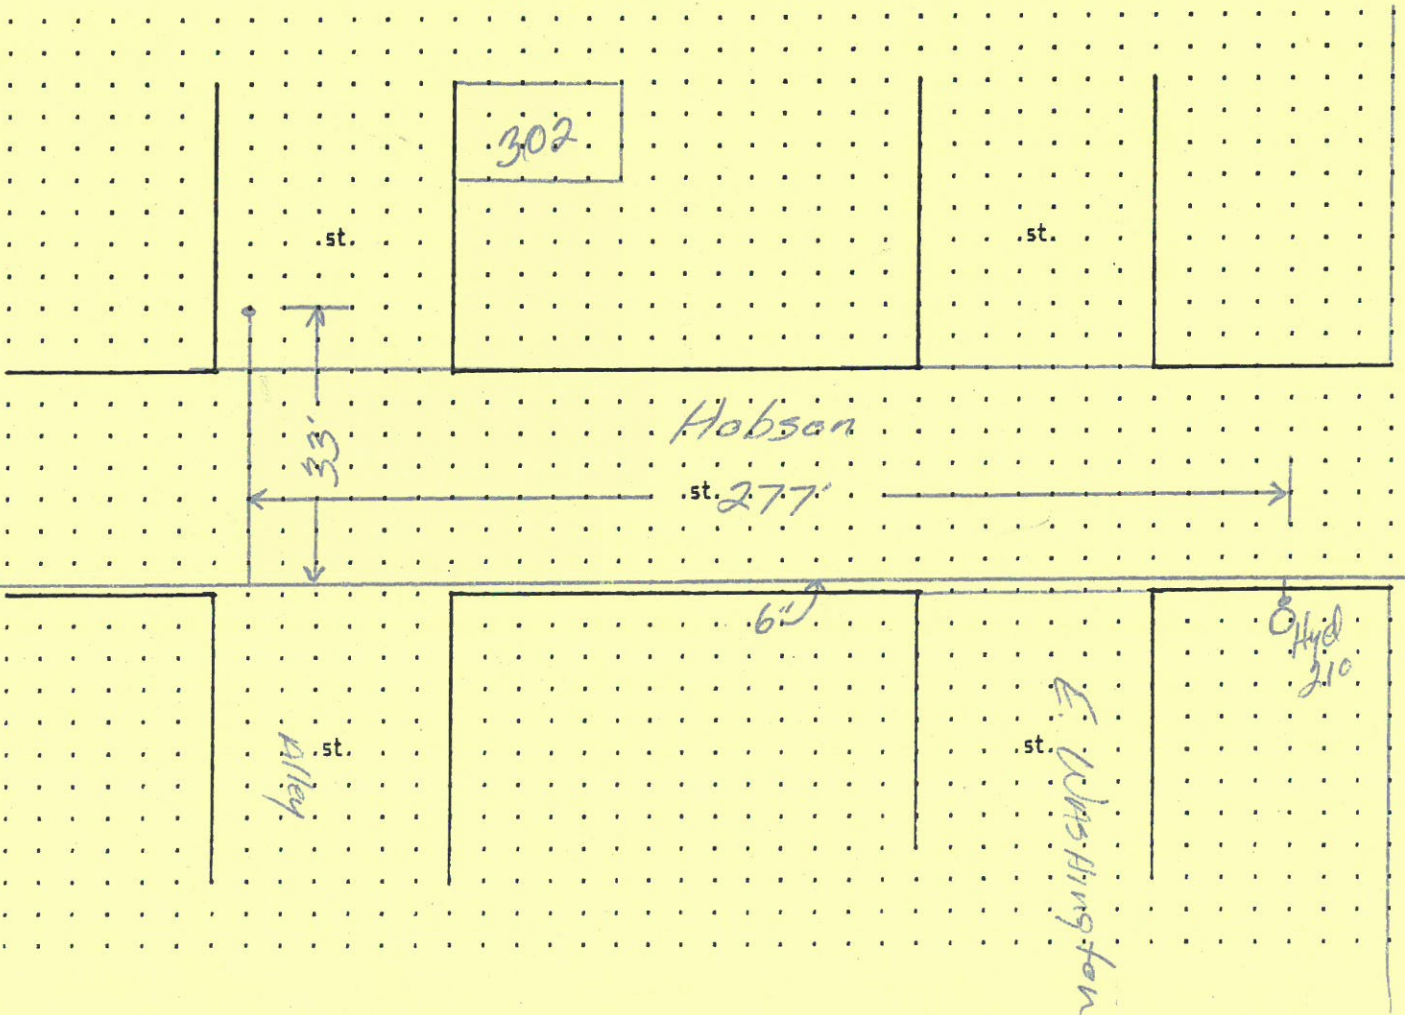



WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0209 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_).00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ \* Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_

Date completed \_\_\_\_\_ Approved by Jeffrey E. Mantel \_\_\_\_\_

water distribution dept.

finance director

Name Saxelotte (old batch plant) Size of tap 2" Date 8-21-97 Street and No. 302 E. Washington

Old Tap No. 3333 New Tap No. 9754 Size and Kind of Main 6" CIP

Location of Main underneath West curb Depth of Main 4 1/2'

Distance from Hydrant/Valve 277' North of Hyd 210 Distance to Curb Stop from Corp. 33'

