



CITY OF NAPOLEON

ENGINEERING DEPARTMENT
255 West Riverview Avenue, P. O. Box 151 Napoleon, OH 43545
Chad E. Lulfs, P.E., P.S., City Engineer
Telephone: 419/592-4010 Fax: 419/599-8393
www.napoleonohio.com

August 2, 2007

Jason Westhoven
122 E. Maumee Avenue
Napoleon, OH 43545

Dear Mr. Westhoven,

It was recently discovered that the sanitary sewer service at 631 E. Washington Street is connected to the sanitary sewer service at 615 E. Washington Street. As per the City of Napoleon's Water & Sewer Rules, sanitary services cannot be shared by multiple buildings. Therefore, you are required to separate your sewer tap from the sewer tap that services the adjacent property. The City of Napoleon's Engineering Department has located the sewer tap for your property. Enclosed are drawings illustrating the approximate locations of your current sewer tap and the sewer tap designated for your property.

The City of Napoleon requires that corrective measures be taken within ninety (90) days from the date of this letter. If you should have any questions or require additional information, please contact our office at your convenience.

Yours truly,

A handwritten signature in black ink, appearing to read "C. Lulfs".

Chad E. Lulfs, P.E., P.S.
City of Napoleon Engineer

Enclosures

cc: Dr. Jon A. Bisher, City Manager
Rex Moll, Construction Inspector
Tom Zimmerman, Building & Zoning
~~Address File~~

=== Line Inspection Report ===

02DCT00 11:48AM

Tape 1
Reports 1-4


DARRS CLEANING
5089 CR 175 CLYDE OHIO
<800>-541-DARR
--- LOCATION HEADER ---
CUSTOMER...:Napoleon
LOCATION...:trunk line
STREET.....:Washington
START MH...:Stout
END MH.....:yard waste *sjte*
TAPE BEG/EN:00:00/29:34


----- LINE DATA -----
PIPE TYPE.:vit
SURFACE....:paved
INSP LENGTH:712 ft
SEWER TYPE.:sanitary
SEWER SIZE.:27 in
REPORT NO. :1.....
OPERATOR...:Roger Darr
FLOW ..:with
DIRECTION...:east

Record: 001
0023.6F ROOT CURTAIN
Record: 002
0030.8F TAP LEFT
Record: 003
0037.4F TAP RIGHT
Record: 004
0110.9F TAP LEFT
Record: 005
0121.0F TAP RIGHT
Record: 006
0175.1F ROOT CURTAIN
Record: 007
0180.5F crack in pipe with heavy roots
Record: 008
0187.8F ROOT CURTAIN
Record: 009
0196.2F ROOT CURTAIN
Record: 010
0217.5F TAP RIGHT flow
Record: 011
0253.2F MANHOLE.....
Record: 012
0285.4F TAP RIGHT roots → 32.2'
Record: 013
0292.8F heavy roots from 175 to 290
Record: 014
0312.1F ROOTS PRESENT
Record: 015
0326.3F ROOT CURTAIN
Record: 016
0340.0F ROOT CURTAIN
Record: 017
0378.7F roots from 312 to 370
Record: 018
0385.1F DEAD TAP RIGHT → 131.9'
Record: 019
0397.8F ROOT CURTAIN
Record: 020
0400.2F TAP RIGHT roots
Record: 021
0448.1F TAP LEFT
Record: 022
0478.3F feeder root
Record: 023
0479.6F TAP RIGHT
Record: 024

over A

Date Installed: 8-1-07
 Installed by: Kim Moore
 Inspected by: Rex Moll

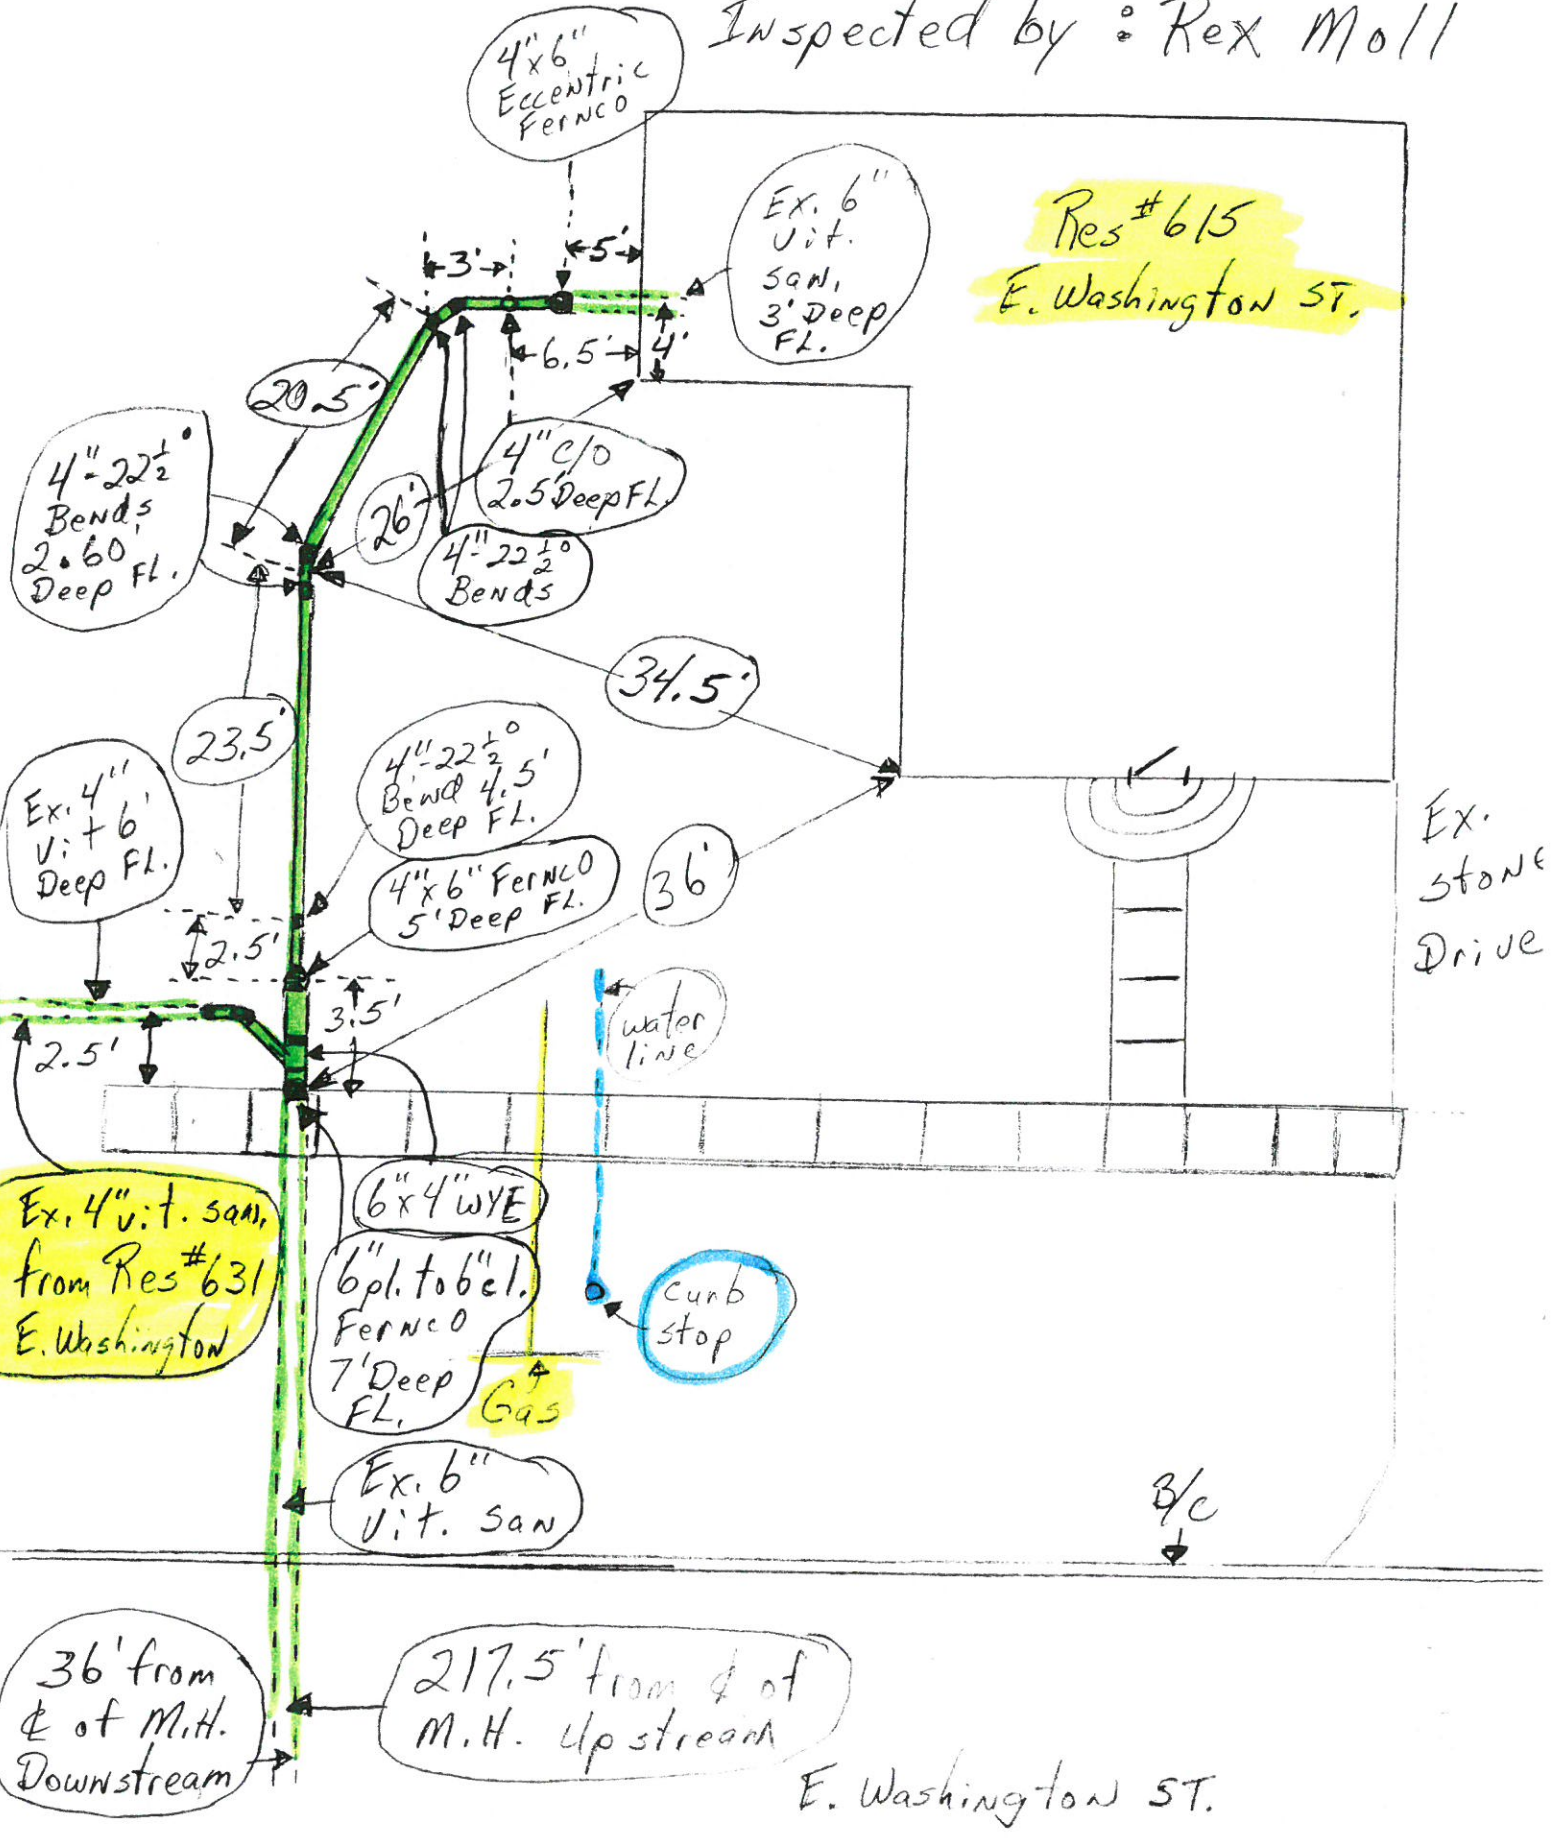

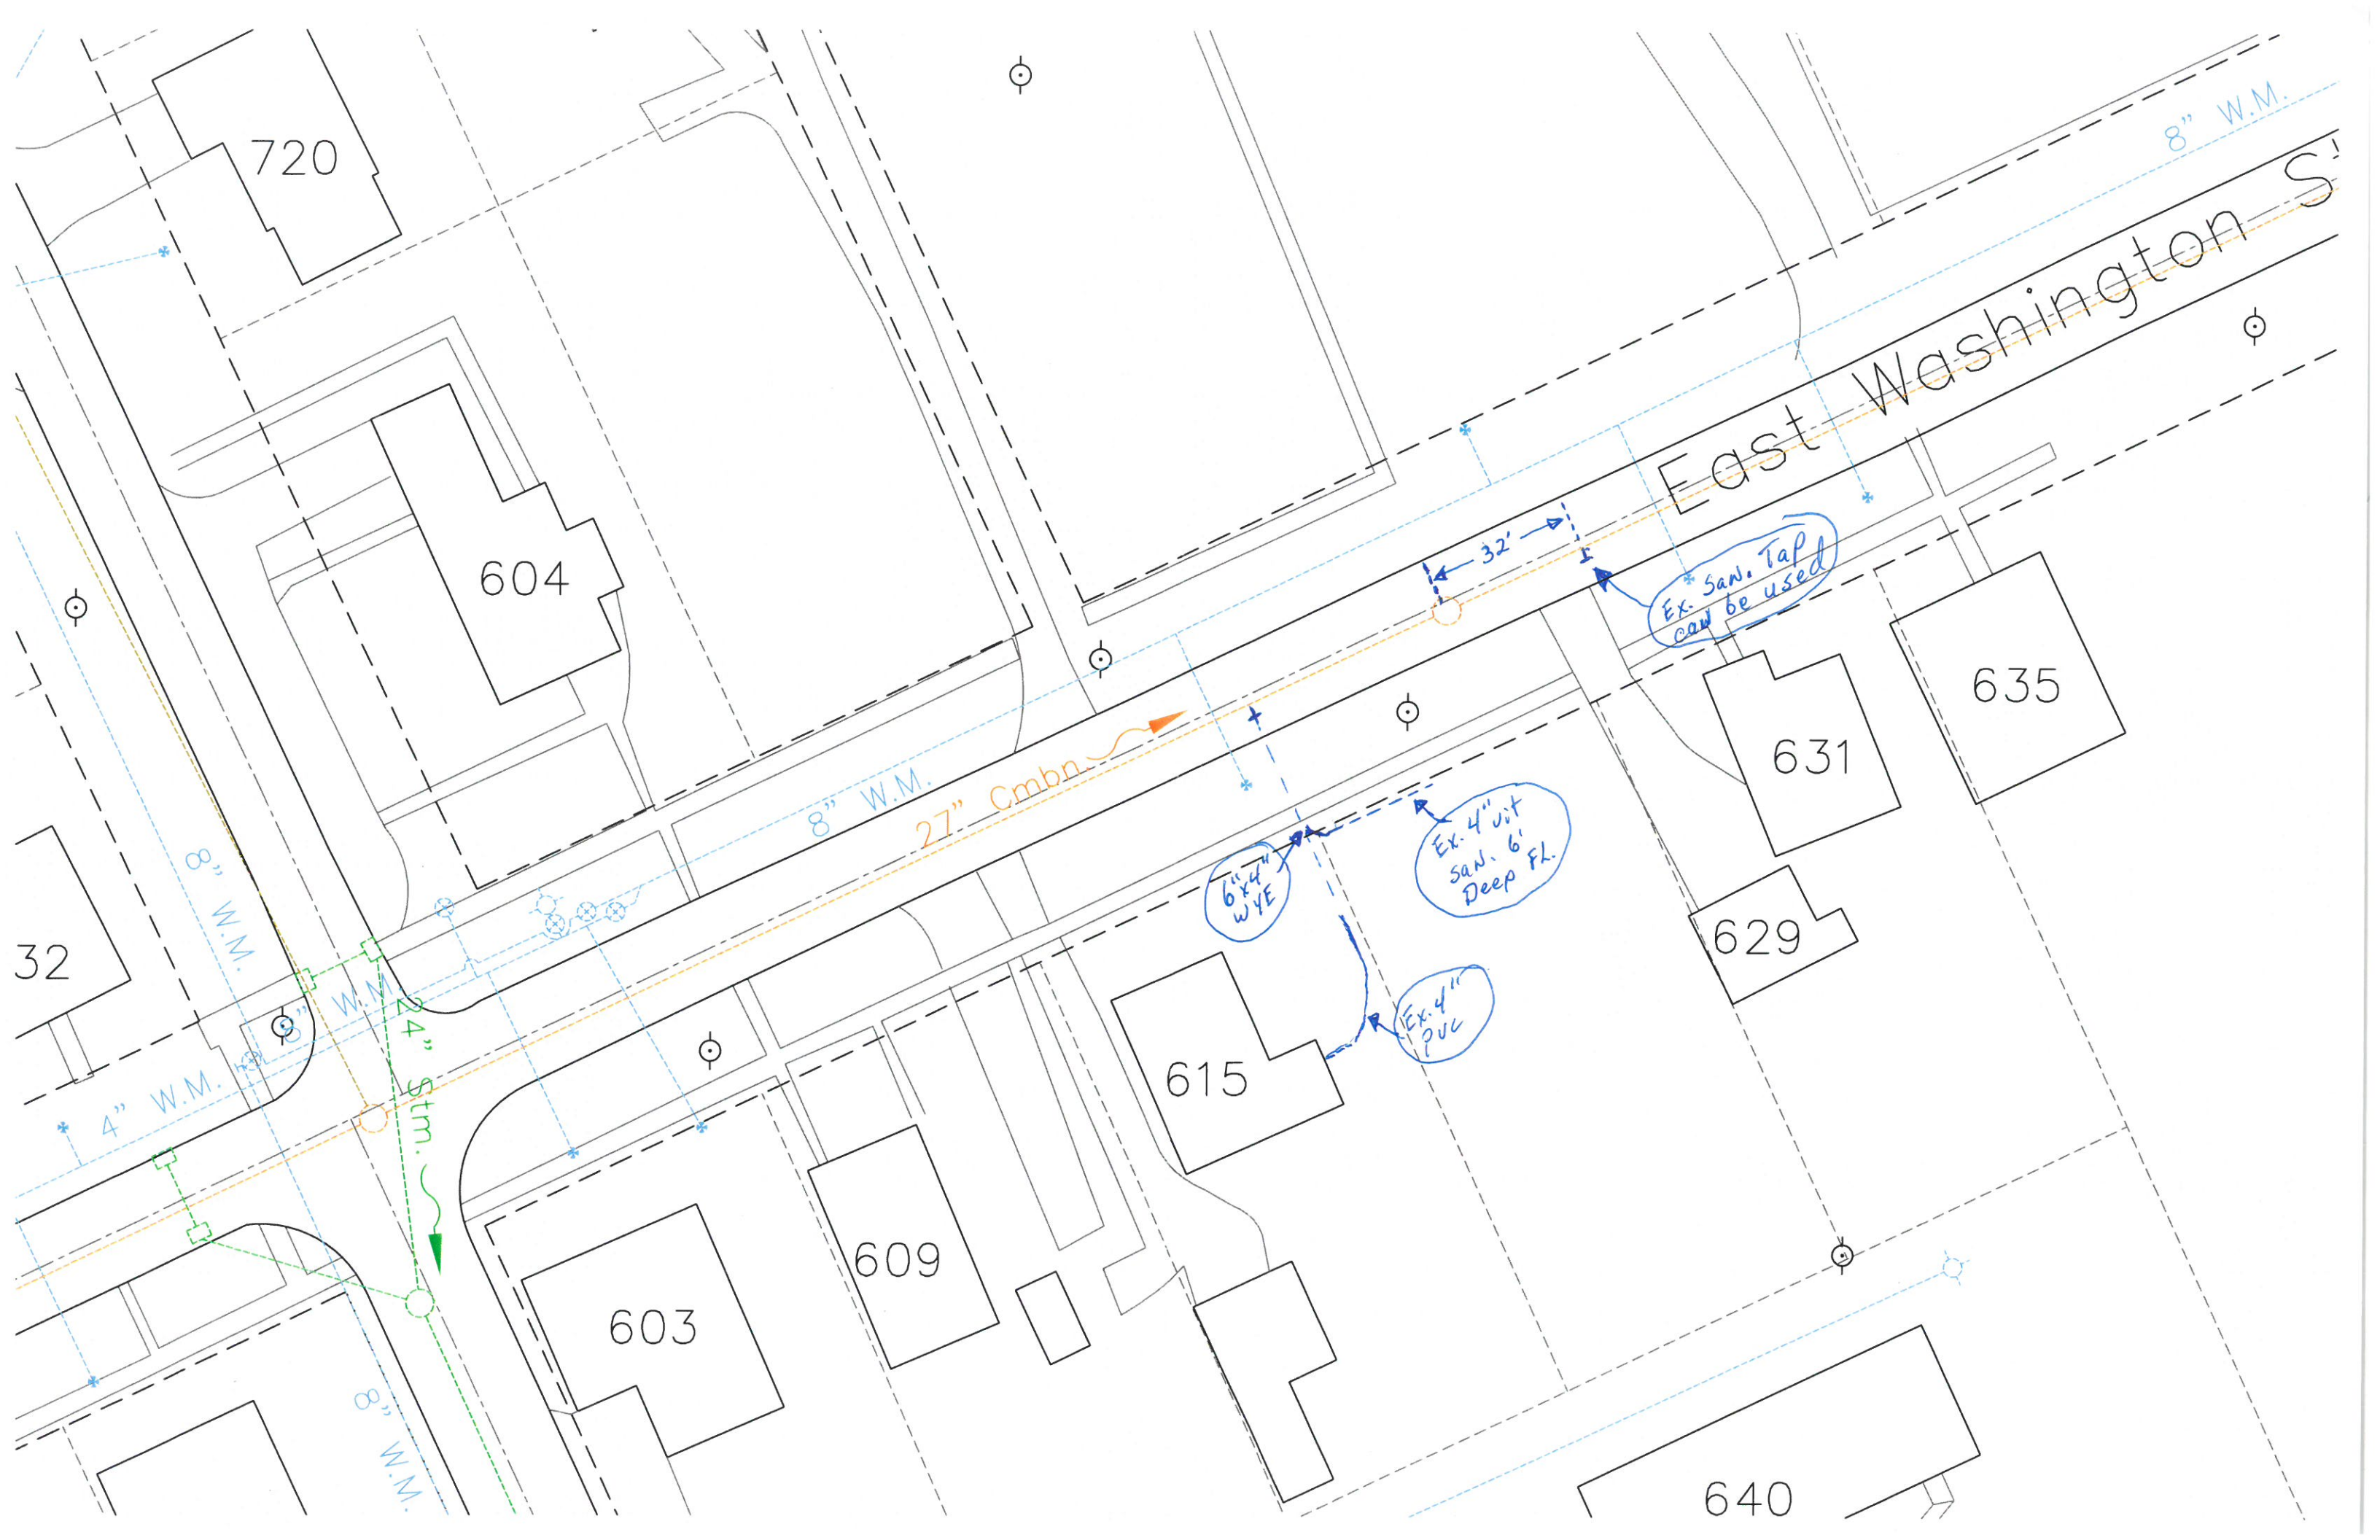

Master Account Inquiry

Master | User Page | Comments | Extra Page | Misc Invoicing

631 E WASHINGTON ST

[MC] [Q5]

Account No 29*02940*6

Last Update 05-14-2007

Account Status A

Balance 142.86

Start Date 04-13-2007

Bill To R



AR Log

Resident

Owner Code 0196

Name VASKO, BRIAN E.
Add1 631 E WASHINGTON ST
Add2
Add3
City NAPOLEON Zip 43545-1822
Tele 419-343-5204 St OH Cr-rt C002
SSan DoB

Landlord
Name WESTHOVEN, JASON
Add1 122 W MAUMEE AVE
Add2
Add3
City NAPOLEON Zip 43545-1950
Tele 592-7598 St OH Cr-rt C001
SSan DoB

- AR
- BH
- PH
- WO
- QM
- Q5
- IQ

Water	Value
Water Status	A
Water Rate	W1
Units	
Book#	29

Sewer	Value
Sewer Status	A
Sewer Rate	S1
Occupants	
Lot#	

Refuse	Value
Refuse Status	A
Refuse Rate	R1
Contract Amt	
Route#	29

Electric	Value
Electric Status	A
Electric Rate	E1
Begin Read	3685
Meter#	B3677

List Book Tenant Prev Next

Print Screen

Text HCopy

Cancel