

INSPECTION RECORD PERMIT

CITY OF NAPOLEON - BUILDING DEPARTMENT
 255 West Riverview Avenue, Napoleon, Ohio 43545 - 419-592-4010

Permit No. 14-78 Issued 1/25/78
date

Job Location 630 W. Washington
address

Lot 42 Sheffields 2nd Add.
sub-div or legal discript

Issued By [Signature]
building official

Owner Gerald Cotter xxx
name tel.

Address 630 W. Washington

Agent Mike Speiser 592-8356
builder-eng.-etc. tel.

Address RR#5 Napoleon

Description of Use Residence, service
change

Residential XX
no. dwelling units

Commercial _____ Industrial _____

New _____ Add'n. _____ Alter XX Remodel XX

Mixed Occupancy _____

Change of Occupancy _____

Estimated Cost \$ 400.75

FEE'S	BASE	PLUS	TOTAL
<input type="checkbox"/> BUILDING			
<input checked="" type="checkbox"/> ELECTRICAL	\$3.00	-0-	\$3.00
<input type="checkbox"/> PLUMBING			
<input type="checkbox"/> MECHANICAL			
<input type="checkbox"/> DEMOLITION			
<input type="checkbox"/> ZONING			
<input type="checkbox"/> SIGN			
WATER TAP			
SEWER TAP			
TEMP. ELECT.		PAID	
ADDITIONAL PLAN REVIEW	Struct. <u>hrs</u> <u>JAN 25 1978</u>		
	Elect. <u>hrs</u> <u>CITY OF NAPOLEON</u>		
TOTAL FEES.....			\$3.00
LESS MIN. FEES PAID _____			-0-
		<small>date</small>	
BALANCE DUE.....			\$3.00

ZONING INFORMATION
n/a

district	lot dimensions	area	front yd	side yds	rear yd
max hgt	no pkg spaces	no ldg spaces	max cover	petition or appeal req'd	date appr

WORK INFORMATION:

Size: Length _____ Width _____ Stories _____ Ground Floor Area _____
 Height _____ Building Volume (for demo. permit) _____ cu. ft.

Electrical: Installing new 200 amp service and 1 new circuit.
brief description

Plumbing: n/a
brief description

Mechanical: n/a
brief description

Sign: _____ Dimensions _____ Sign Area _____
type

Additional Information: All work shall conform to the N.E.C. 1978 edition NFPA 70.

Date _____ Applicant Signature _____
owner-agent

INSPECTION RECORD

	UNDERGROUND			ROUGH-IN			FINAL					
	Type	Date	By	Type	Date	By	Type	Date	By			
PLUMBING	Building Drains			Drainage, Waste & Vent Piping			Indirect Waste			Drainage, Waste & Vent Piping		
	Water Piping									Backflow Prevention		
	Building Sewer			Water Piping			Condensate Lines			Water Heater		
	Sewer Connection									FINAL APPROVAL		
MECHANICAL	Refrigerant Piping			Refrigerant Piping			Chimney(s)			Grease Exhaust System		
				Duct Furnace(s)			Fire Dampers			Air Cond. Unit(s)		
	Ducts/Plenums			Ducts/Plenums			<input type="checkbox"/> Radiant Htr(s) <input type="checkbox"/> Unit Htr(s)			Refrigeration Equipment		
				Duct Insulation			Pool Heater			Furnace(s)		
			Combustion Products Vents			Ventilation <input type="checkbox"/> Supply <input type="checkbox"/> Exhst.				FINAL APPROVAL		
ELECTRICAL	Conduits & or Cable			Conduits/Cable			<input type="checkbox"/> Range <input type="checkbox"/> Dryer			Temp Service Temp Lighting		
	Grounding & or Bonding			Rough Wiring			<input type="checkbox"/> Generator(s) <input type="checkbox"/> Motors			Fixtures Lampholders		
	Floor Ducts Raceways			Service Panel Switchboard			<input type="checkbox"/> Water Htr <input type="checkbox"/> Welder			Signs		
	Service Conduit			Busways Ducts			<input type="checkbox"/> Heaters <input type="checkbox"/> Heat Cable			Electric Mtr. Clearance		
	Temporary Power Pole			Subpanels			<input type="checkbox"/> Duct Htr(s) <input type="checkbox"/> Furnace(s)			FINAL APPROVAL		
BUILDING	Location, Set-backs, Esmt(s)			Exterior Wall Construction			Roof Covering Roof Drainage			Smoke Detector		
	Excavation						Exterior Lath			Demolition (sewer cap)		
	Footings & Reinforcing						<input type="checkbox"/> Interior Lath <input type="checkbox"/> Wallboard					
	Floor Slab			Interior Wall Construction			Fire Wall(s)			Building or Structure		
	Foundation Walls			Columns & Supports			Fireplace Chimney					
	Sub-soil Drain			Crawl Space <input type="checkbox"/> Vent <input type="checkbox"/> Access			Attic <input type="checkbox"/> Vent <input type="checkbox"/> Access					
	Piles			Floor System(s)						FINAL APPROVAL BLDG. DEPT.		
			Roof System			Special Insp Reports Rec'd				Certificate of Occupancy Issued		
ADDITIONAL	INSPECTIONS, CORRECTIONS, ETC.						INSPECTIONS, CORRECTIONS, ETC.					
	(3-30-78) Stopped for Insp. no one home - NH											

CITY OF NAPOLEON
BUILDING INSPECTION DEPARTMENT
APPLICATION FOR ELECTRICAL PERMIT
(PLEASE PRINT OR TYPE)

#3.00
14-78

The undersigned hereby makes application for the installation, replacement, or alteration of electrical equipment as herein specified, agreeing to do all such work in strict accordance with the City of Napoleon's adopted Electrical Code for 1, 2 and 3 Family Buildings.

Owner's Name Gerald Cotter Address 630 W. Washington Tel. none
Contractor's Name Mike Speiser Address R.R.#1 Tel. 592_8356

LOT INFORMATION:

Location of Project 630 W. Wash. Zoning District Res.

BUILDING INFORMATION:

Single Family X Double Family _____ Multiple Family _____
New Construction _____ Existing X Addition _____
Replacement _____ Remodel _____ Service Change X
Size: Total Square Foot Per Floor _____ No. of Stories 2

DESCRIPTION OF WORK

Size of Service 200 AMP. Service Change Only No (Yes or No)

Total Number of New Circuits _____ Total Number of New Circuits
Excluding Appliance Circuits _____

APPLIANCE CIRCUITS: (indicate quantity)

Electric Range _____ Range Hood _____ Clothes Dryer 1 Dishwasher _____

Air Conditioner _____ Attic Fan Blower _____ Room Exhaust Fan _____

Disposal _____ Hot Water Heater _____ Electric Oven _____

Require Temporary Electric No (Yes or No)

Note: G.F.I.C. required for all temporary electric with approved ground rod at service

APPLICATION FOR PERMIT SHALL BE ACCOMPANIED BY TWO COMPLETE SETS OF PLANS INCLUDING: ELECTRICAL LAY-OUT AND RISER DIAGRAM.

ESTIMATED COST OF COMPLETED PROJECT: \$400.75

DATE 1/23/78 APPLICANT'S SIGNATURE Mike Speiser

OWNER-CONTRACTOR-AGENT

Date: 1-25-78

TO: Electric Distribution Superintendent

FROM: The Building Inspector - Building Department

Please confirm the installation of 200 AMP. electrical service entrance, located ? Same

at the following address: 630 W. WASHINGTON

Approved 1-25-78

Not Approved

K. Ruge
Electric Supt.

1-25-78
Date

Remarks: Will split load of this transformer
& Run new secondary at that time




REISER DIAGRAM

For;
Mr. & Mrs Gerald Cotter
630 W. Washington St.
Napoleon Ohio

Contractor:
Mike Speiser

1/19/78

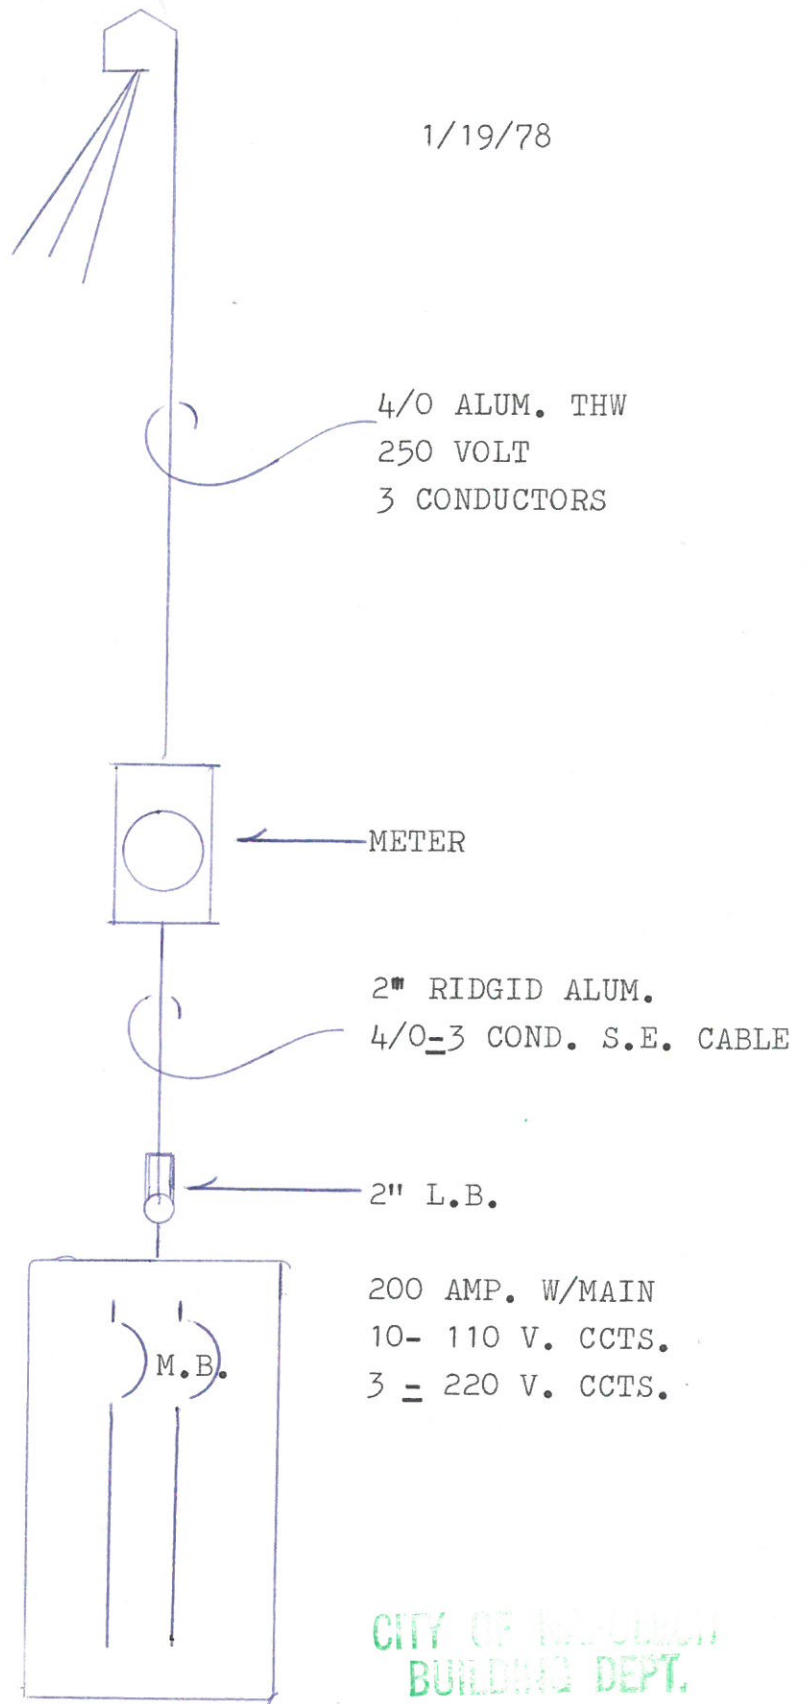

CITY OF NAPOLEON
BUILDING DEPT.

Plan Approval


By _____ Date _____

REISER DIAGRAM

For;
Mr. & Mrs Gerald Cotter
630 W. Washington St.
Napoleon Ohio

Contractor:
Mike Speiser

1/19/78

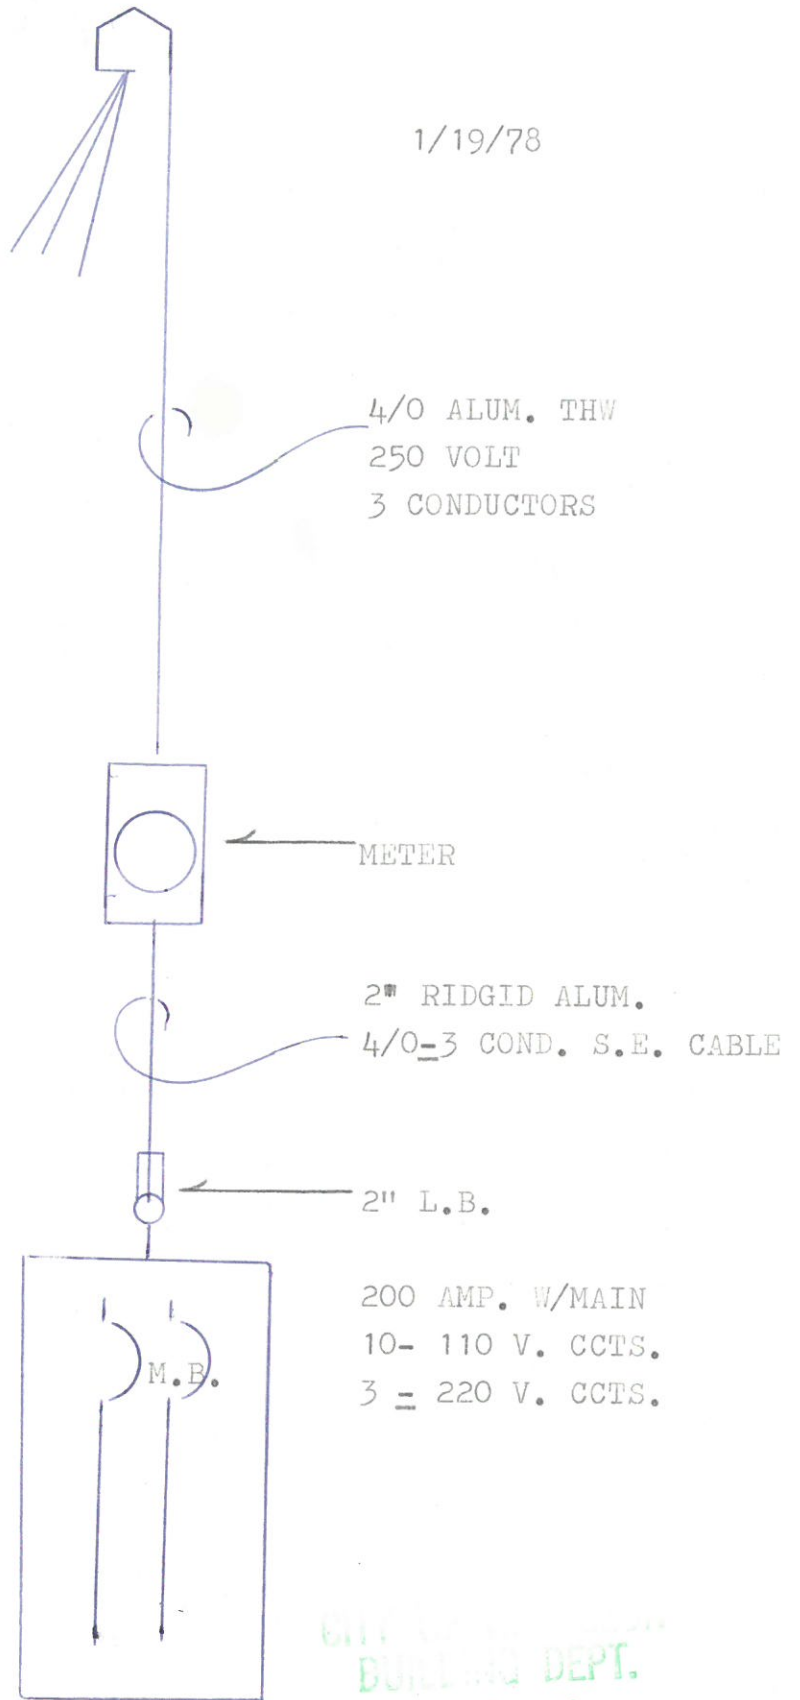

CITY OF NAPOLEON
BUILDING DEPT.
-Plan Approval
By _____ Date _____

