

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0324 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by H. H. Montgomery water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 1-13-98 Street and No. 616 Webster

Old Tap No. 2696 New Tap No. 9804 Size and Kind of Main 8" C-900

Location of Main 8' East of East Curb Depth of Main 5'

Distance from Hydrant/Valve 157' North of Hyd 470 Distance to Curb Stop from Corp. 2'

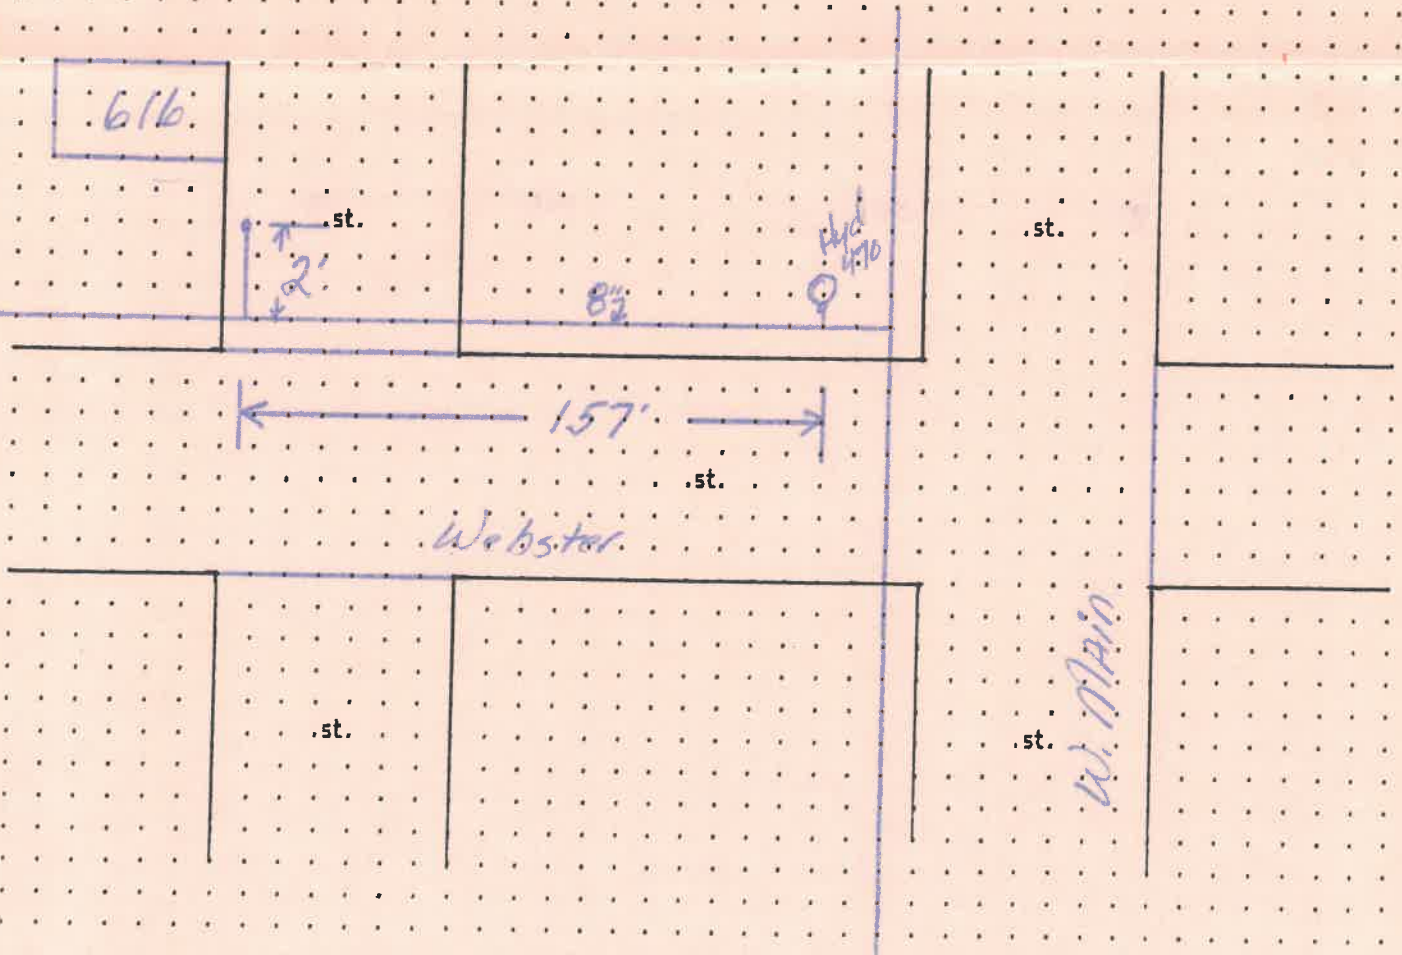

WATER TAPPING PERMIT
 issued by
 The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0325 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by Jeffrey E. Mantel
 water distribution dept. _____ finance director

Name Apt B Size of tap 1" Date 1-13-98 Street and No. 616 Webster

Old Tap No. _____ New Tap No. 9805 Size and Kind of Main 8" C-900

Location of Main 8' EAST OF EAST CURB Depth of Main 5'

Distance from Hydrant/Valve 162' North of Hyd 470 Distance to Curb Stop from Corp. 4'
 (unpaid tap)

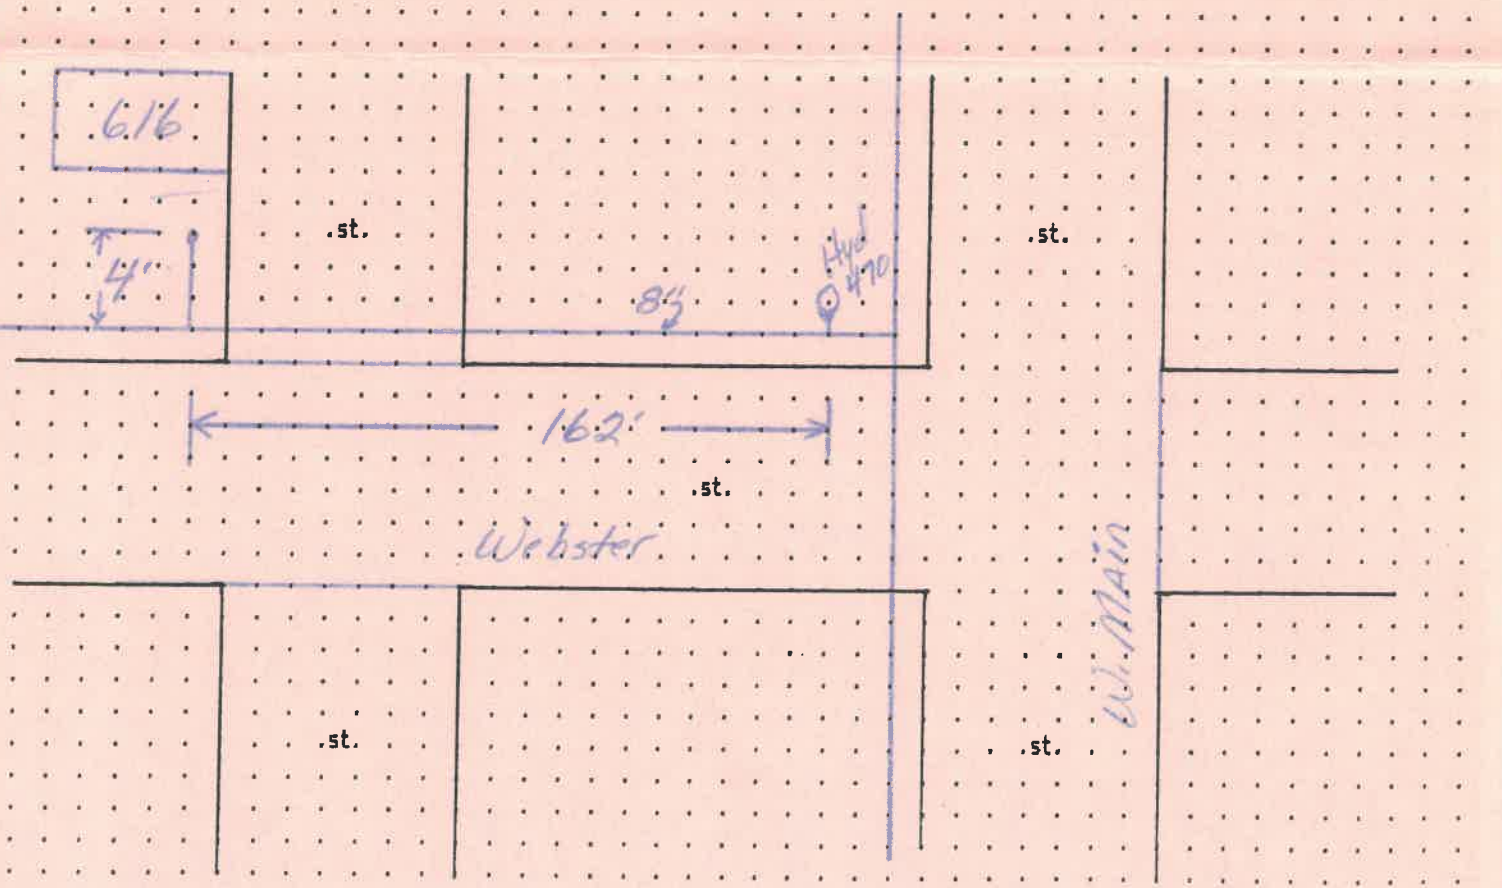

(This tap put in for future hook-up turned off @ CURB STOP)

WATER TAPPING PERMIT
 issued by
The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0326 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by Philip E. MacLaughlin water distribution dept. _____ finance director

Name Apt C Size of tap 1" Date 1-13-98 Street and No. 616 Webster

Old Tap No. — New Tap No. 9806 Size and Kind of Main 8" C-900

Location of Main 8' EAST OF EAST CURB Depth of Main 5'

Distance from Hydrant/Valve 165' North of Hyd 470 (unpaid tap) Distance to Curb Stop from Corp. 4'

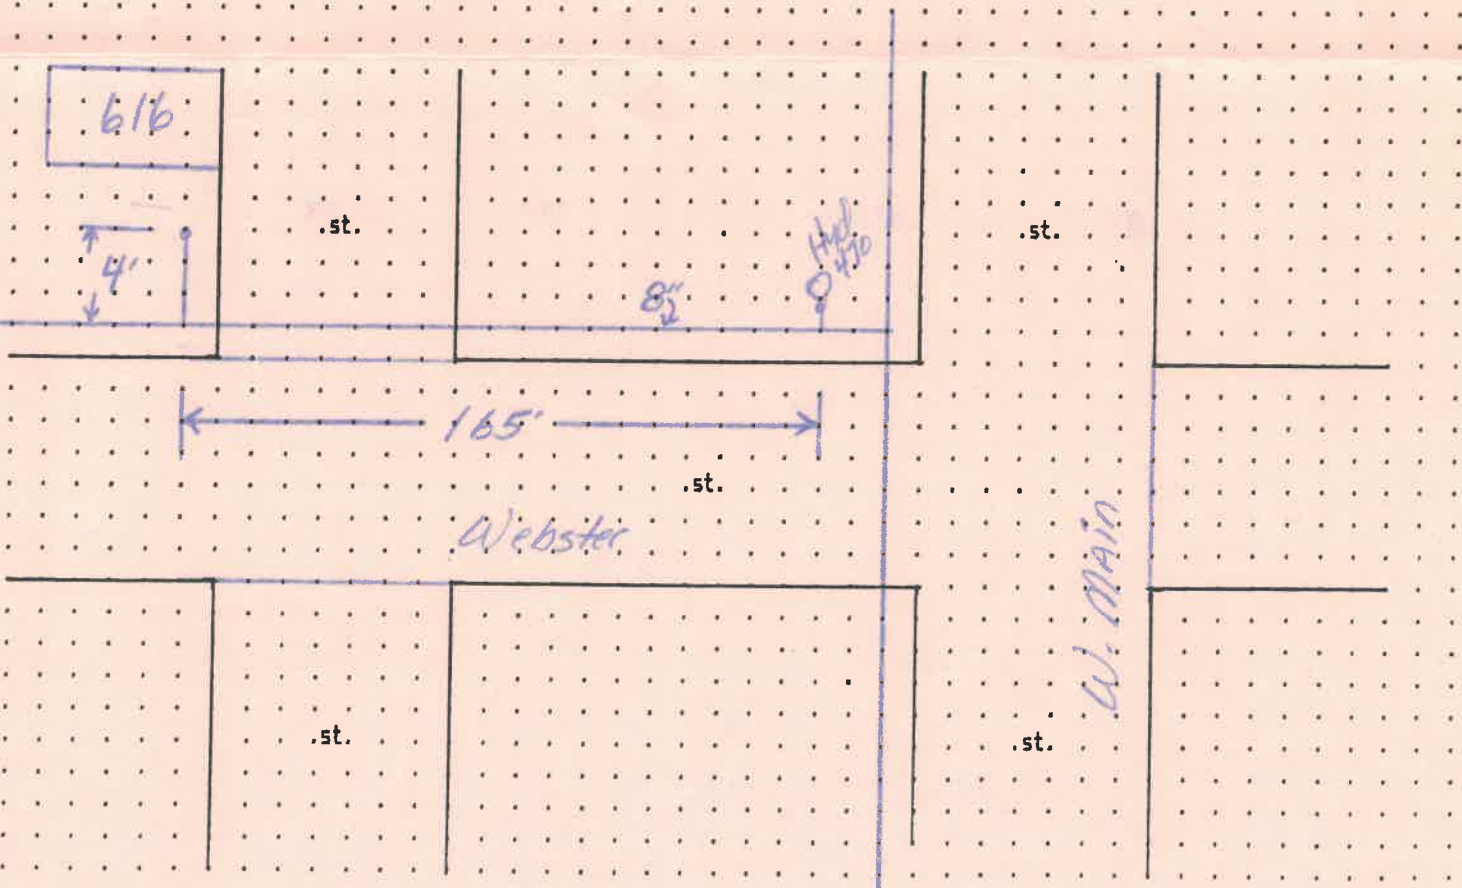

(This tap put in For Future hook-up turned off @ curb stop)

WATER TAPPING PERMIT
issued by
The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0326 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by Jeffrey P. Mantel water distribution dept. _____ finance director

Name Apt C Size of tap 1" Date 1-13-98 Street and No. 616 Webster

Old Tap No. — New Tap No. 9806 Size and Kind of Main 8" C-900

Location of Main 8' East of East curb Depth of Main 5'

Distance from Hydrant/Valve 165' North of Hyd 470 Distance to Curb Stop from Corp. 4'
(unpaid tap)

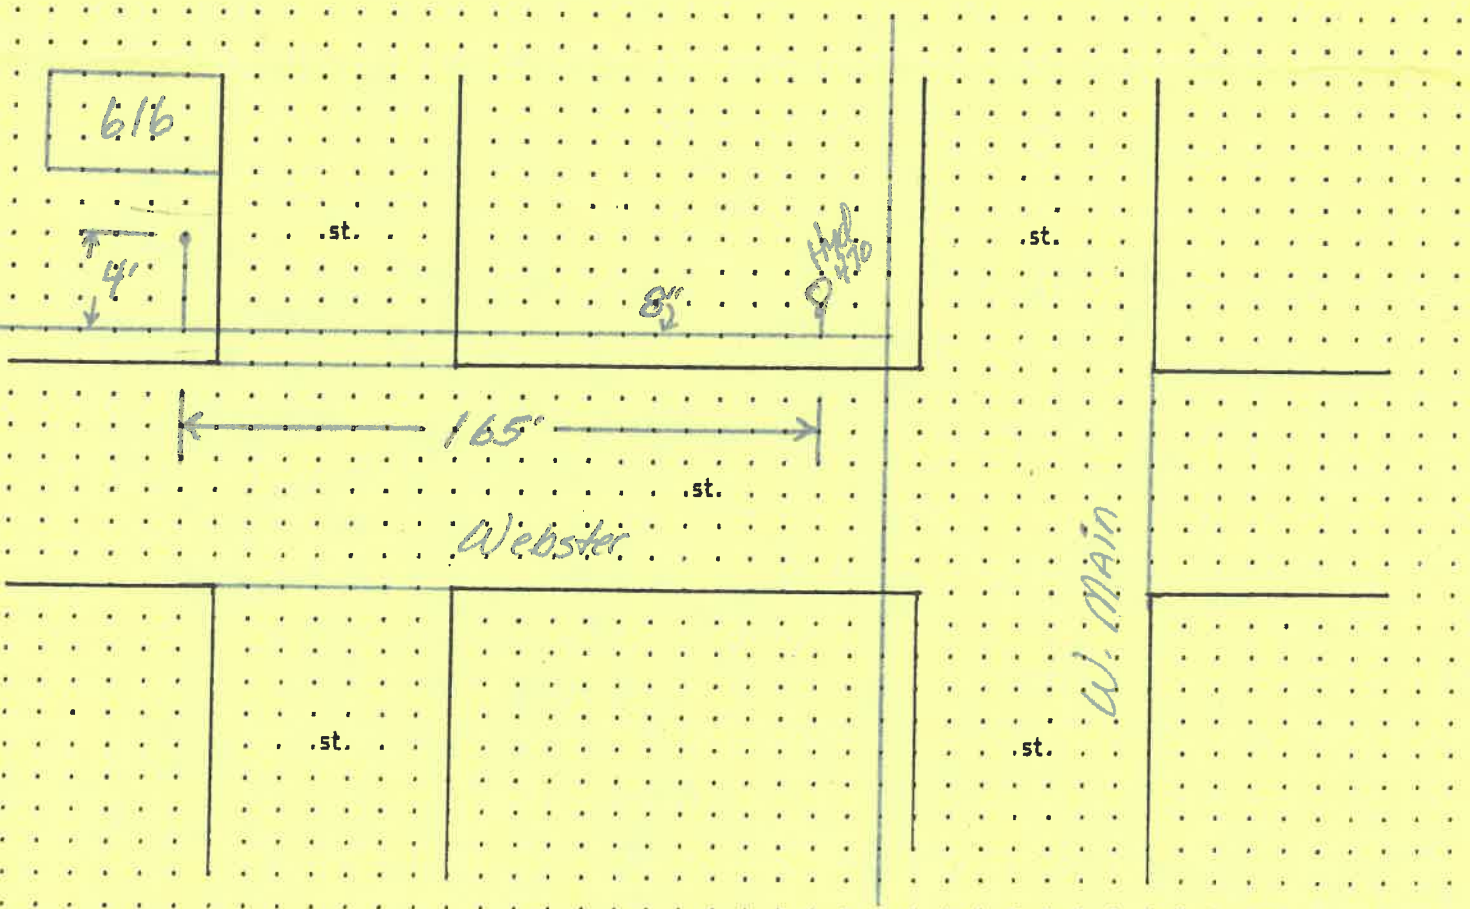

(This tap put in for future hook-up turned off @ curb stop)

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43345 Ph. 592-4010

Permit No. W-0325 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by Phyllis Mantel water distribution dept. _____ finance director

Name Apt B Size of tap 1" Date 1-13-98 Street and No. 616 Webster

Old Tap No. _____ New Tap No. 9805 Size and Kind of Main 8" C-900

Location of Main 8' East of East Curb Depth of Main 5'

Distance from Hydrant/Valve 162' North of Hyd #70 Distance to Curb Stop from Corp. 4'
(unpaid tap)



(This tap put in for future hook-up turned off @ CURB STOP)

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0324 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by *[Signature]* _____

water distribution dept.

finance director

Name _____ Size of tap 1" Date 1-13-98 Street and No. 616 Webster

Old Tap No. 2696 New Tap No. 9804 Size and Kind of Main 8" C-900

Location of Main 8' East of East Curb Depth of Main 5'

Distance from Hydrant/Valve 157' North of Hyd 470 Distance to Curb Stop from Corp. 2'

