

WATER TAPPING PERMIT

Issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W- _____ Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____


Date completed Oct 28, 1999 Approved by Alfred E. Mantz water distribution dept. _____ finance director

Name Note: Future tap Size of tap 1" Date 8-99 Street and No. 428 Welsted

Old Tap No. _____ New Tap No. 9950 Size and Kind of Main 8" C-900

Location of Main 4' North of South CURB Depth of Main 5'

Distance from Hydrant/Valve 200' West of Hyd 36 Distance to Curb Stop from Corp. 29'

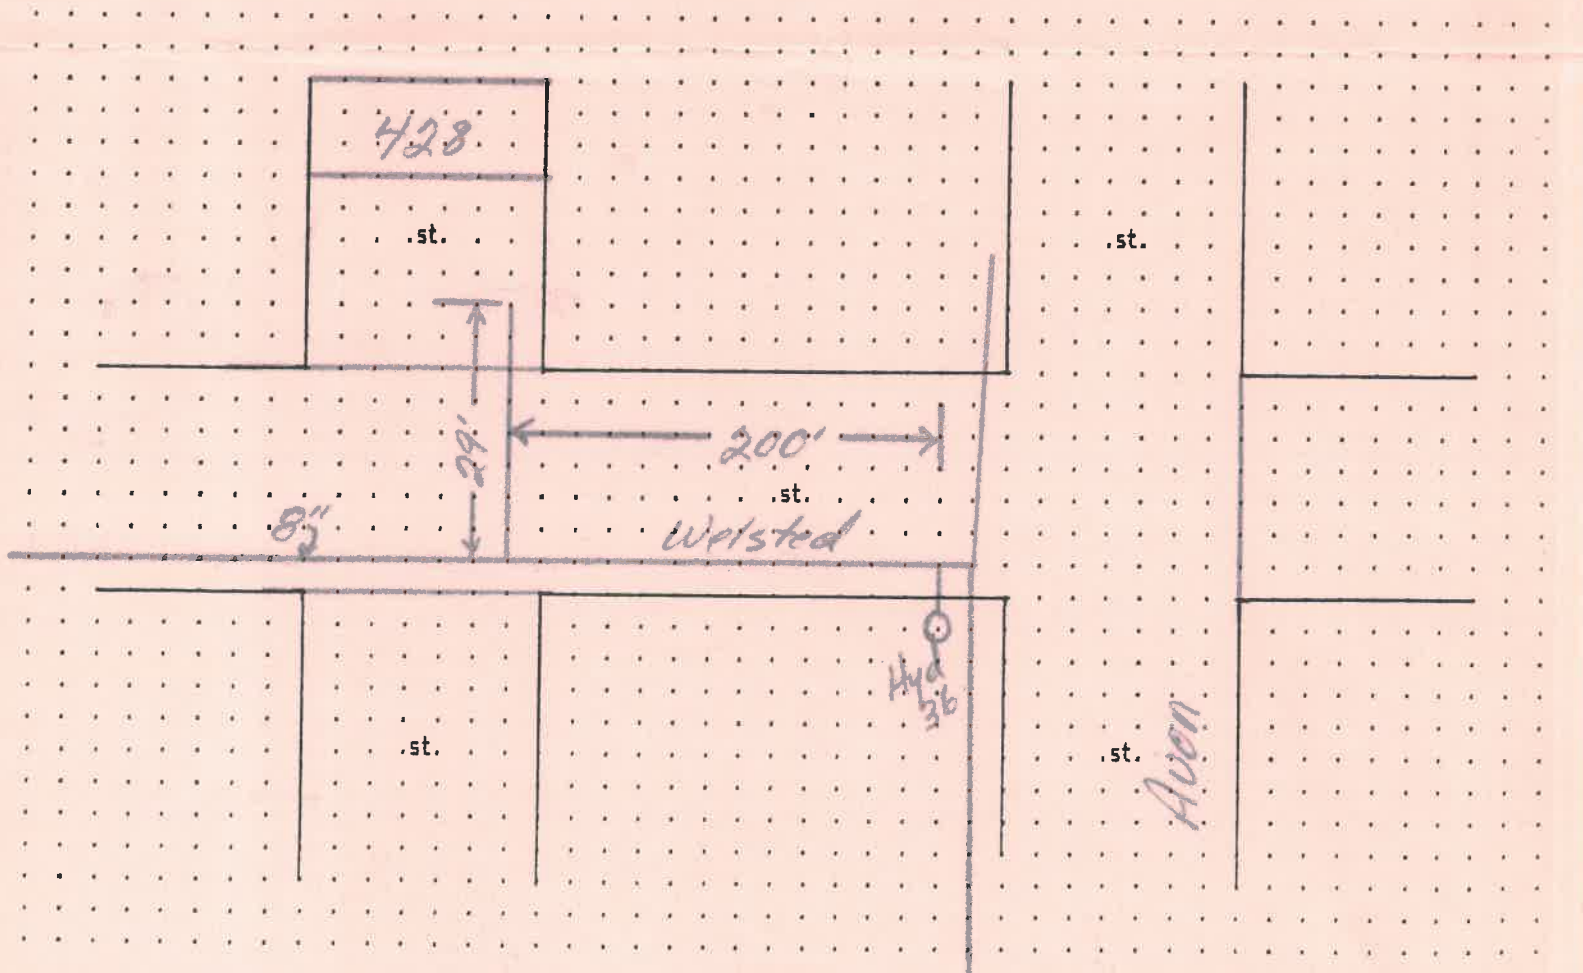

WATER TAPPING PERMIT

Issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W- _____ Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ Cost \$ _____ .00 Plumber _____

Date completed Oct 28, 1999 Approved by [Signature] water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 8-99 Street and No. 428 Welsted

Old Tap No. 3407 New Tap No. 9951 Size and Kind of Main 8" C-900

Location of Main 4' North of South curb Depth of Main 5'

Distance from Hydrant/Valve 255' West of Hyd 36 Distance to Curb Stop from Corp. 32'

