


was into
 See Dig →
 metric
 ke
 1.5 ft Tee
 in the basement
 room
 SPI + 2 + 3
 for
 take valves.

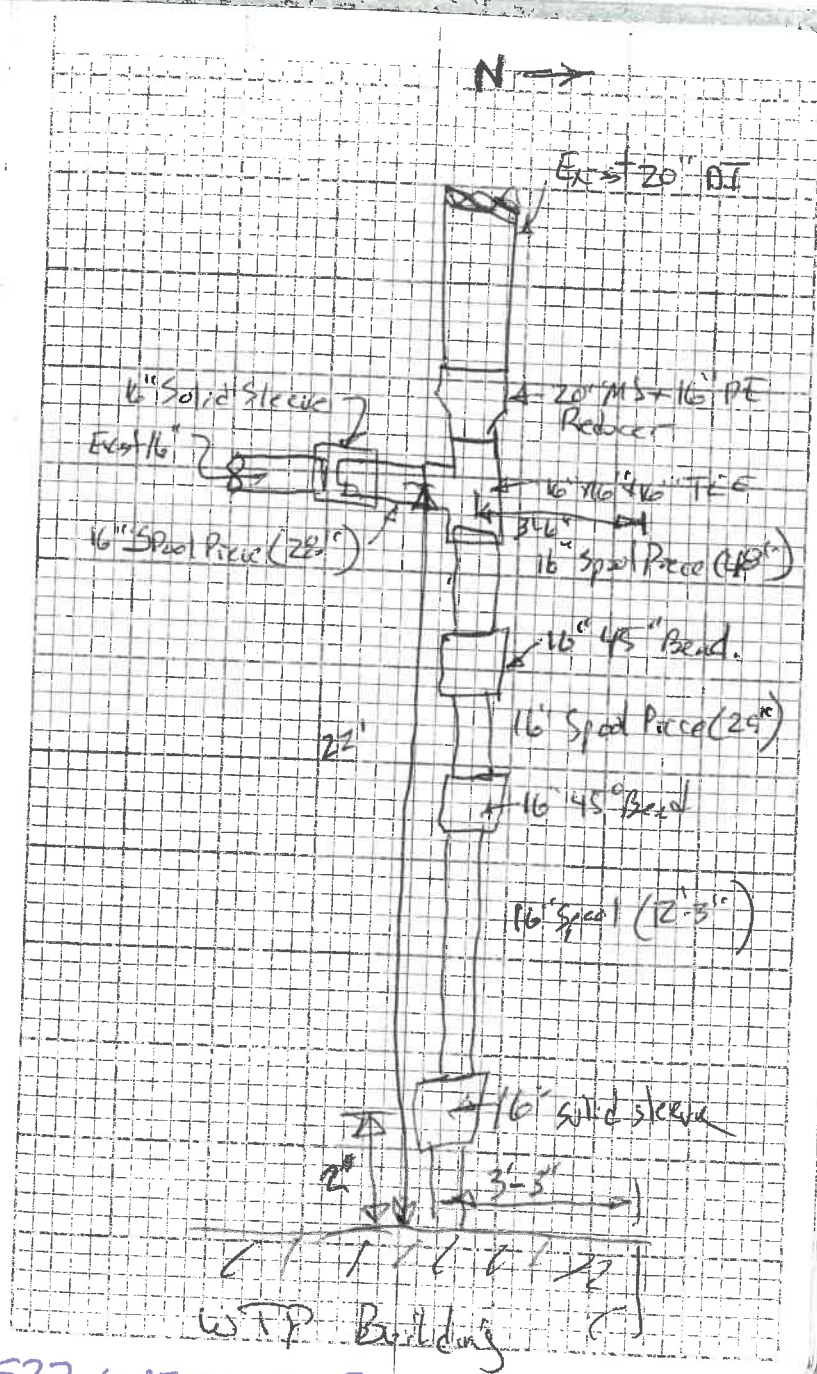

527 WELSTED ST.

WATER TREATMENT PLANT

12-7-10

INSPECTOR - BRAD MEYER