

WATER TAPPING PERMIT
 issued by
The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0344 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by Henry E. Montague water distribution dept. finance director

Name German Mutual Bldg Size of tap 6" Date 6-98 Street and No. 1000 Westmoreland

Old Tap No. _____ New Tap No. 9830 Size and Kind of Main 8" C-900

Location of Main 15' South of Pavement edge Depth of Main 5'

Distance from Hydrant/Valve 51' East of Hyd 473 Distance to Curb Stop from Comp. 1'
 (Fire line)

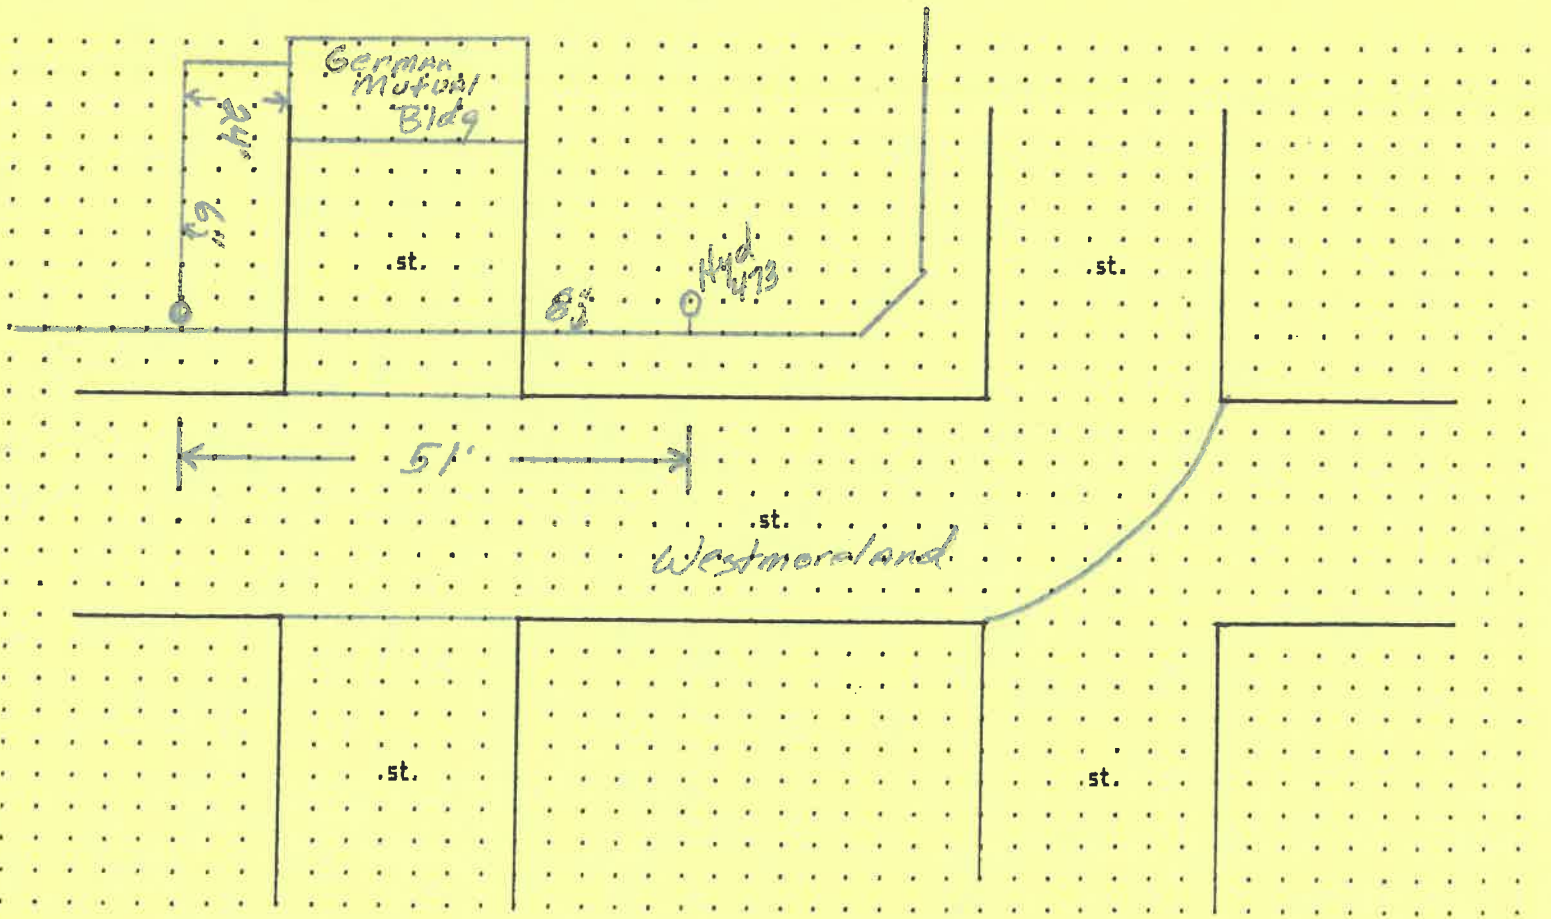

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0344 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by William E. M... [Signature] water distribution dept. _____ finance director

Name German Mutual Bldg Size of tap 6" Date 6-98 Street and No. 1000 Westmerland

Old Tap No. _____ New Tap No. 9830 Size and Kind of Main 8" C-900

Location of Main 15' South of Pavement edge Depth of Main 5'

Distance from Hydrant/Valve 51' East of Hyd 473 Distance to Curb-Stop from Comp. 1'
(Fire line)

