

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0191 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by Jeffrey C. Marshall water distribution dept. _____ finance director

Name Napoleon School BUS GARAGE Size of tap 2" Date 5-13-97 Street and No. 700 Westmoreland

Old Tap No. _____ New Tap No. 9707 Size and Kind of Main 8" C 900

Location of Main 14' North of South curb Depth of Main 6 1/2'

Distance from Hydrant/Valve 210' East of Hyd 466 Distance to Curb Stop from Corp. 16'

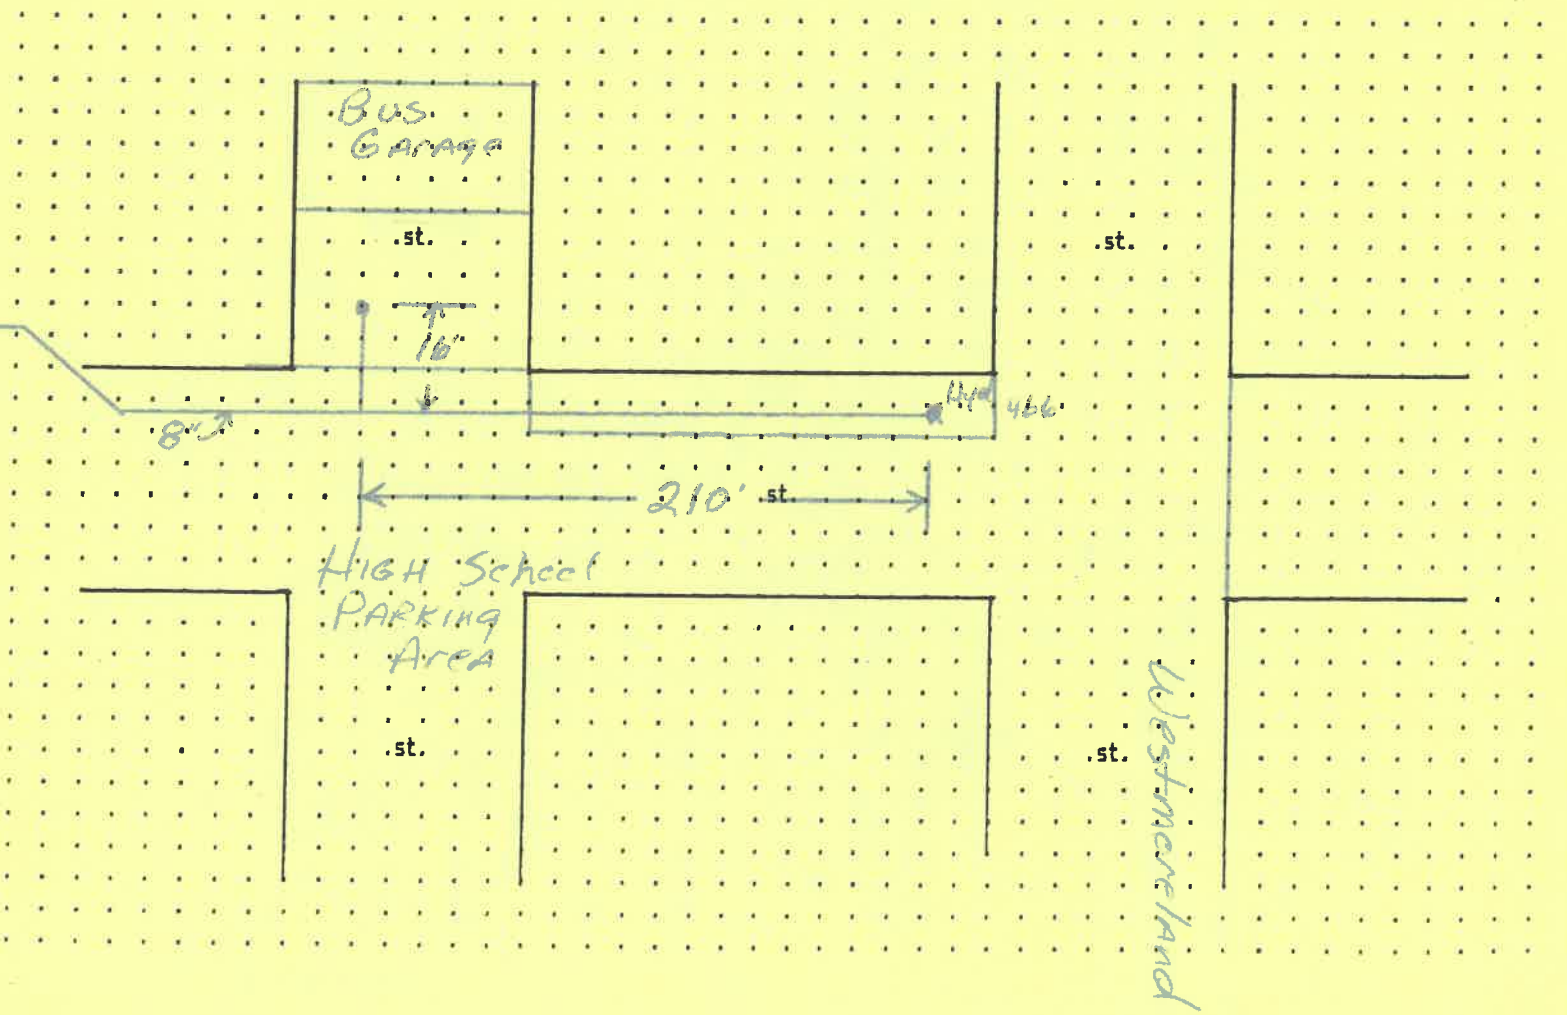

WATER TAPPING PERMIT
 issued by
The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0191 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by Jeffrey C. Mantel
 water distribution dept. _____ finance director

Name Napoleon School BUS GARAGE Size of tap 2" Date 5-13-97 Street and No. 700 Westmoreland

Old Tap No. _____ New Tap No. 9707 Size and Kind of Main 8" C-900

Location of Main 14' North of South curb Depth of Main 6 1/2'

Distance from Hydrant/Valve 210' East of Hyd 466 Distance to Curb Stop from Corp. 16'

