

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0348 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_).00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ " Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_


Date completed \_\_\_\_\_ Approved by James P. MacLaughlin water distribution dept. \_\_\_\_\_ finance director

Name MARY Drummond Size of tap 1" Date 8-19-98 Street and No. 1025 Woodlawn

Old Tap No. 548 New Tap No. 9834 Size and Kind of Main 6" CIP

Location of Main 1' South of South curb Depth of Main 4 1/2'

Distance from Hydrant/Valve 396' E of Hyd 138 Distance to Curb Stop from Corp. 7'

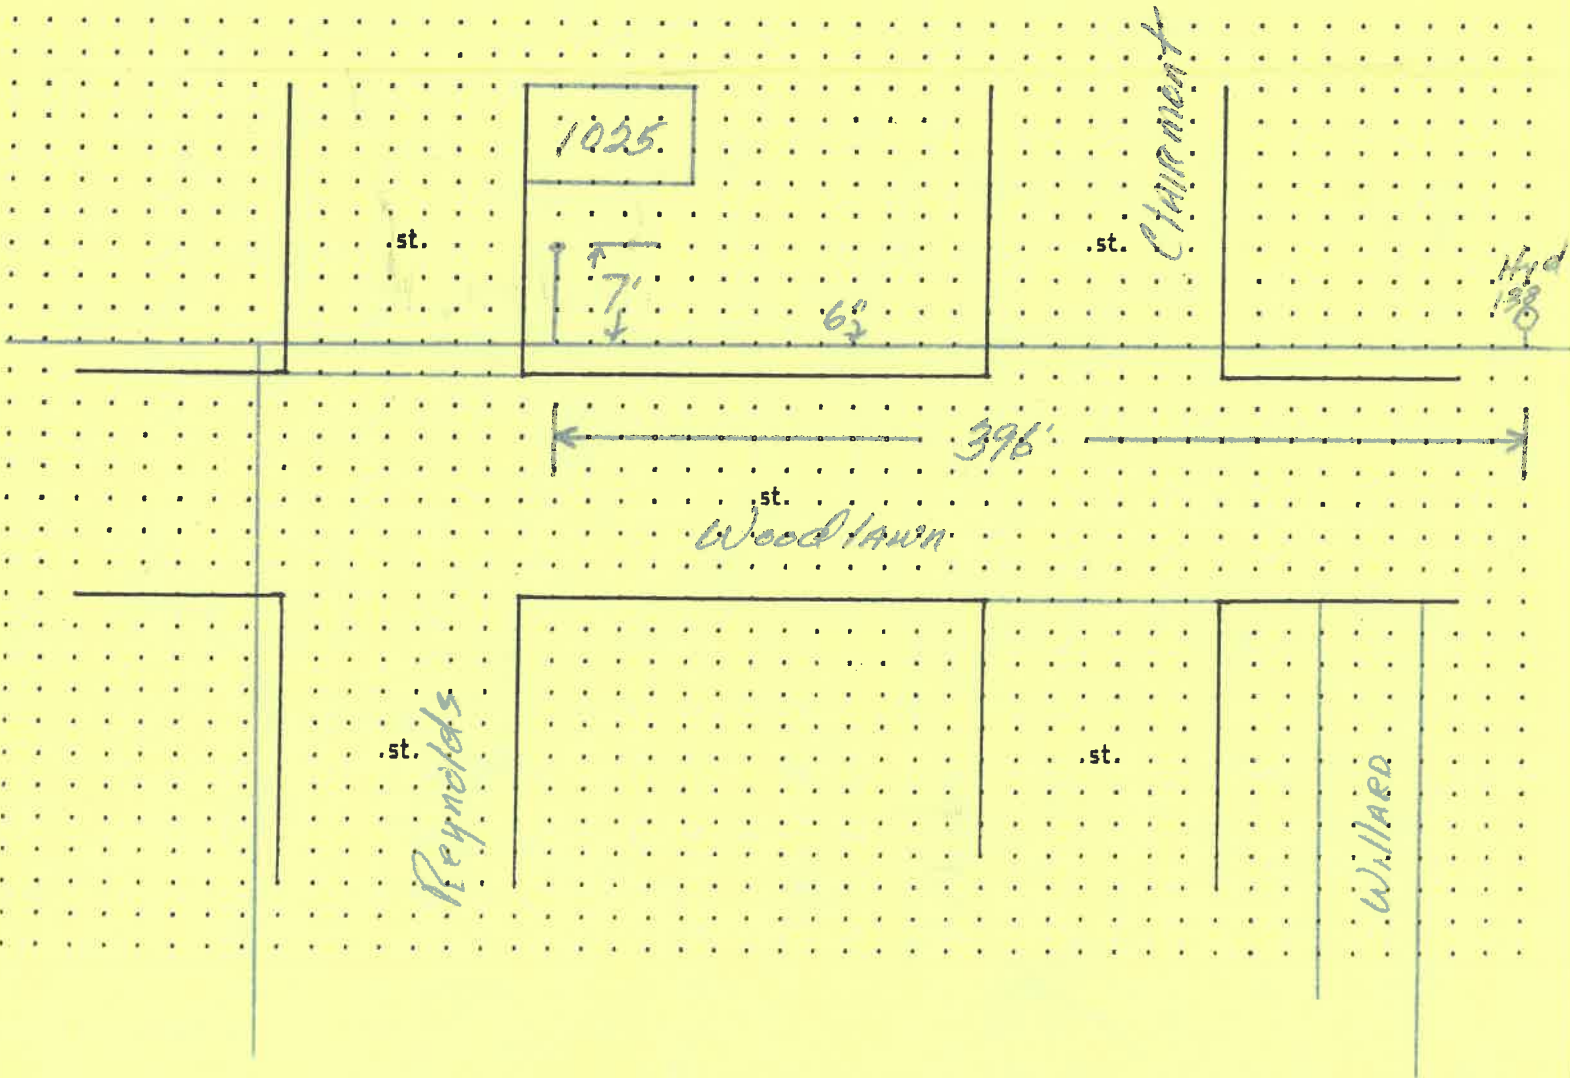

**WATER TAPPING PERMIT**  
 issued by  
**The Napoleon Water Distribution Department**  
 255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W-0348 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_) .00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ " Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_

Date completed \_\_\_\_\_ Approved by Ally P. Manlyugh water distribution dept. \_\_\_\_\_ finance director

Name MARY Drummend Size of tap 1" Date 8-19-98 Street and No. 1025 Woodlawn

Old Tap No. 548 New Tap No. 9834 Size and Kind of Main 6" CIP

Location of Main 1' South of South curb Depth of Main 4 1/2'

Distance from Hydrant/Valve 396' E of Hyd 138 Distance to Curb Stop from Corp. 7'

