

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W-0254 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by John E. Montague water distribution dept. _____ finance director

Name John Halden Size of tap 1" Date 4-2-96 Street and No. 1159 Woodlawn

Old Tap No. 776 New Tap No. 9621 Size and Kind of Main 6" CIP

Location of Main 2' South of South pavement Depth of Main 4 1/2'

Distance from Hydrant/Valve 19' West of Hyd 137 Distance to Curb Stop from Corp. 6'

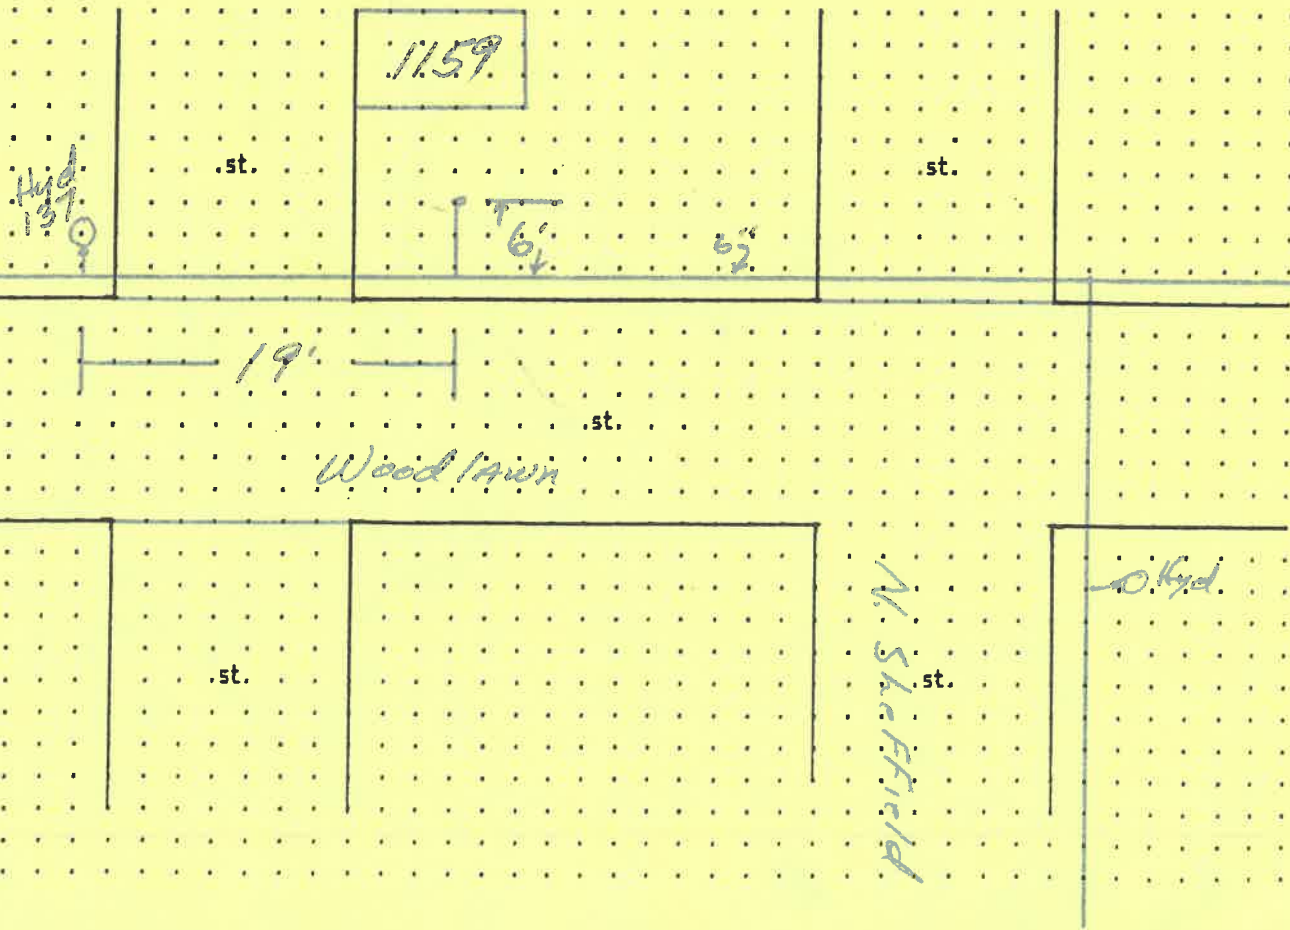

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43345 Ph. 592-4010

Permit No. W- 0254 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by Jeffrey C. Montague
water distribution dept. _____ finance director

Name John Holden Size of tap 1" Date 4-2-96 Street and No. 1159 Woodlawn

Old Tap No. 776 New Tap No. 9621 Size and Kind of Main 6" CIP

Location of Main 2' South of South pavement Depth of Main 4 1/2'

Distance from Hydrant/Valve 19' West of Hyd 137 Distance to Curb Stop from Corp. 6'

