

CITY OF NAPOLEON
BUILDING INSPECTION DEPARTMENT
APPLICATION FOR BUILDING PERMIT
(please print or type)

The undersigned hereby makes application for construction, installation, or alternation work as herein specified, agreeing to do all such work in strict accordance with the City of Napoleon's adopted Building Codes.

Location of project ¹⁴³⁰ WOODLAWN AVE Cost of Project 63,800⁰⁰

Owner's Name HARRY BRINKMAN Address WOODLAWN AVE

Contractor GERMANN BUILDERS Telephone No. 592-1806

Address 970 OAKWOOD AVE.

Lot Information: (not required for siding job)

Lot No. 1 Subdivision BRINKMAN ADDITION

Zoning District _____ Lot Size 85.35 ft x 314.38 ft. Area 27,042 sq. ft.

Setbacks: Front 77 Right Side 30.35 Left Side 9 Rear 181.38

Work Information:

Residential Commercial _____ Industrial _____

New Construction Addition _____ Remodel _____

Accessory Building _____ Siding VINYL Specific Type _____

Brief Description of Work: NEW RESIDENCE

Size: Length 56' Width 46' No. of Stories 1 1/2

Area: 1st Floor 2096 sq. ft. Basement 1288 sq. ft.

2nd Floor 874 sq. ft. Accessory Building _____ sq. ft.

3rd Floor _____ sq. ft. Other _____ sq. ft.

Additional Information: _____

*APPLICATION FOR PERMIT SHALL BE ACCOMPANIED BY TWO COMPLETE SETS OF PLANS INCLUDING: ELEVATIONS, FLOOR PLANS, CROSS SECTIONS AND PLOT PLAN. IF ADDITION OR REMODELING, SHOW ALL EXISTING STRUCTURES AND THEIR SIZE AND LOCATION. ALL PLANS SHALL BE DRAWN TO SCALE.

Date 3/8/88 Applicant's Signature [Signature]

OFFICE OF THE SUPERVISOR
 PLUMBING INSPECTION DEPARTMENT
 DIVISION OF PLUMBING PERMITS
 (Printed print or type)

The undersigned hereby authorizes the installation or improvement of plumbing work in the above specified premises in accordance with the City of Chicago's various Plumbing Codes, (1, 2 and 3 family dwelling units only).

Owner's Name HARRY BRINKMAN Address WOODLAWN AVE

Plumbing Contractor BILL ELLING Telephone No. 599-1786

Address 1201 WOODLAWN

General Contractor GERMANN BUILDERS Telephone No. 592-1806

Address 970 OAKWOOD

Location of Project WOODLAWN AVE Cost of Project 5000⁰⁰

Other Information:

No. of dwelling units New Replacement Addition

Brief description of work: NEW RESIDENCE

Is water tap required Size Type of Pipe

Is sewer tap required Size Type of Pipe

Type of Water Distribution Pipe Copper

Type of Drainage, Waste and Vent Pipe ABS-DMU Plastic

Type of main building drain 4" Size of main vent pipe 3"

Bathrooms	<u>2</u>	Toilet	<u>1</u>	Trap Size	<u>1 1/2"</u>	Shower	<u>1</u>	Trap Size	<u>2"</u>
-----------	----------	--------	----------	-----------	---------------	--------	----------	-----------	-----------

Kitchens	<u>2</u>	Trap Size	<u>1 1/2"</u>	Refrigerator	<u>1</u>	Trap Size	<u>1 1/2"</u>	Disposal	<u>No.</u>	Trap Size	<u>No.</u>
----------	----------	-----------	---------------	--------------	----------	-----------	---------------	----------	------------	-----------	------------

Washers	<u>1</u>	Trap Size	<u>1 1/2"</u>	Other	<u>LAUNDRY SINK</u>	Trap Size	<u>1 1/2"</u>
---------	----------	-----------	---------------	-------	---------------------	-----------	---------------

All installations are subject to inspection and approval of the undersigned.

3/8/88

Inspector's Signature

Robert W. Germain

PLUMBING PERMITS
 DIVISION OF PLUMBING PERMITS

* HEADER SIZES

* SOLID BLOCKING BETWEEN JOISTS

WINDOW SIZE

LIV. RM KIT + DIN RM OK

BRO RM 17.5 SF, 11.25

5
16.25

ANDRESON WOOD

FLOOR JOISTS # 2 VP = 1400 + 1,6 = E

FIRST FLOOR JOISTS OK

2ND FLOOR JOISTS OK

CRIC JOISTS GARAGE OK

GAR RAFTERS OK

2 FL CRIC JOISTS OK

HOOSH 2x8 RAFTERS OK

BEAM

UJR 3 1/2" x 13 1/2" LAM

BEAM,

12' SPAN

			P.L.F.
2ND FLOOR	LOAD	9.5' x 40# P.S.F.	= 380 LBS
ATTIC	LOAD	4.5' x 30# P.S.F.	= 135 LBS
ROOF	LOAD	13.67' x 30# P.S.F.	= 410 LBS
TOTAL			<u>925 LBS.</u>

BEAM BASEMENT W-8 x 15# MAX. SPAN 9'-0"

FIRST FL	LOAD	14' x 50# P.S.F.	= 700 #
2ND FL.	LOAD	9.5' x 40# P.S.F.	= 380 #
ROOF	LOAD	13.67' x 30# P.S.F.	= 410 #
ATTIC	LOAD	4.5' x 30# P.S.F.	= 135 #
			<u>1625 #</u>

$$1625 \# \times 9' = 14,625$$

W-8 x 15 = ALLOW LOAD 28,888 LBS.

100 Nov 7-28-76

01110
PERMIT NO.

34.00

CITY OF NAPOLEON
BUILDING INSPECTION DEPARTMENT
APPLICATION FOR HEATING PERMIT
(PLEASE PRINT OR TYPE)

The undersigned hereby makes application for the installation, repla or alteration of a heating system or device as herein specified, agr to do all such work in strict accordance with the City of Napoleon's adopted Mechanical Code for 1, 2 and 3 Family Buildings.

Owner's Name Harry Brinkman Address Woodlaum
Contractor's Name Bills Alby & Htg Address 1201 Woodlaum Tel 599-1986

BUILDING INFORMATION:

Single Family Double Family _____ Multiple _____ New Construction
Addition _____ Remodel _____ Replacement _____ No. of Stories _____

DESCRIPTION OF WORK

Heating System - Warm Air _____ Hot Water Steam _____ Electric _____

Unit Heaters _____ Unit Gas Heaters _____ Other _____

Type - Gravity _____ Forced _____ Radiant _____

No. of Thermostatical Heating Zone 2

Hot Water - One Pipe Two Pipe _____ Series Loop _____

Electric Heat - No. of Circuits _____ Other _____

Total Heat Loss of Area to be Heated 105000

Rated Capacity of Furnace/Boiler 125000

No. of Furnaces _____ No. of Hot Air Runs 17

No. of Hot Water Radiators 116' Type of Fuel nat gas

Heating Units Located: Crawl Space _____ Floor Level Suspended _____

Roof or Exposed to Outside Air _____ Attic _____ Other _____

APPLICATION FOR PERMIT SHALL BE ACCOMPANIED BY TWO COMPLETE SETS OF P INCLUDING: LOCATION OF FURNACE OR UNIT HEATERS AND SIZE AND LOCATION FEEDER DUCTS AND RETURN AIR DUCTS. ALL PLANS SHALL BE DRAWN TO SCALE

ESTIMATED COST OF COMPLETED PROJECT: 6128.00

DATE 4-18-88 APPLICANT'S SIGNATURE William Elling
OWNER-CONTRACTOR-AGEN

BUILDING INSPECTION DEPARTMENT
APPLICATION FOR ELECTRICAL PERMIT
(Please print or type)

The undersigned hereby makes application for installation or replacement of electrical equipment as herein specified, agreeing to do all such work in strict accordance with the City of Napoleon's adopted Electrical Codes.

Owner's Name HARRY J. BRINKMAN Address 1430 Woodlawn Ave. Nap.

Electrical Contractor SELF Telephone No. 758-3266

Address 1430 Woodlawn Ave. Nap.

General Contractor GERMAN BUILDERS Telephone No. 592-1806

Address 970 Oakwood Ave. Napoleon, O.

Location of Project 1430 Woodlawn Cost of Project \$80,000.00

Work Information:

Residential 1 1/2 STORY W/ BASEMENT Commercial _____ Industrial _____
No. Units _____

New Service Change _____ Rewiring _____ Additional Wiring _____

Brief Description of Work: _____

Size of proposed service entrance 200 AMP Number of new circuits 26

Type of proposed service entrance _____ Underground Overhead _____

Require Temporary Electric _____ (Yes or No)

Total Floor Area - Commercial and Industrial only _____ sq. ft.

Additional Information: _____


*Ground fault circuit interrupter protection is required on all 120-volt single phase, 15 and 20 amp. Circuits which are part of a temporary electric service; and also on bathroom, outdoor, and garage receptacles in all dwelling units. Art. 220-8 N.E.C.

Application for permit shall be accompanied by two complete sets of plans including: Electrical layout and riser diagram. (For commercial and industrial work only).

date 3-18-88

Applicant's Signature Harry J. Brinkman

PERMIT NO. \$

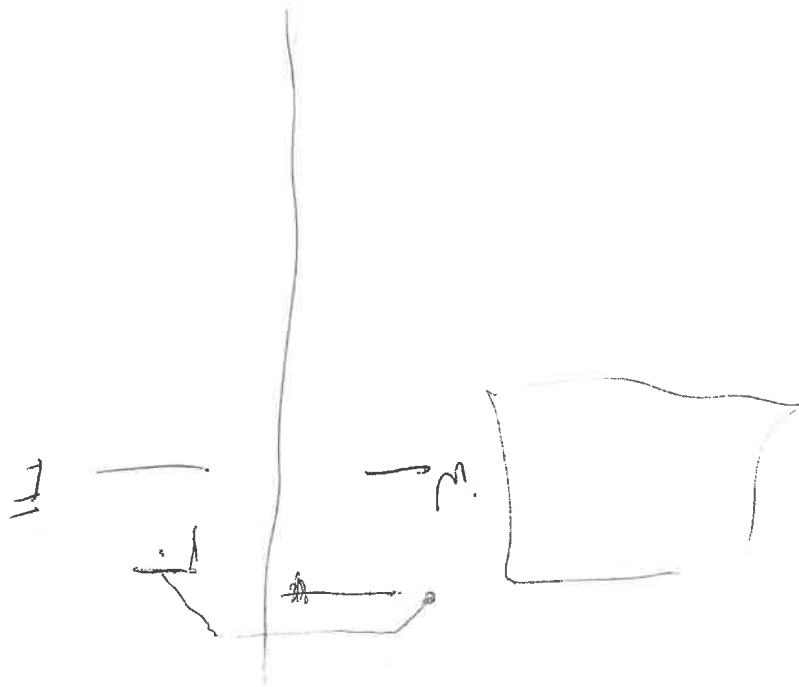

2

②