


North

Existing House


West

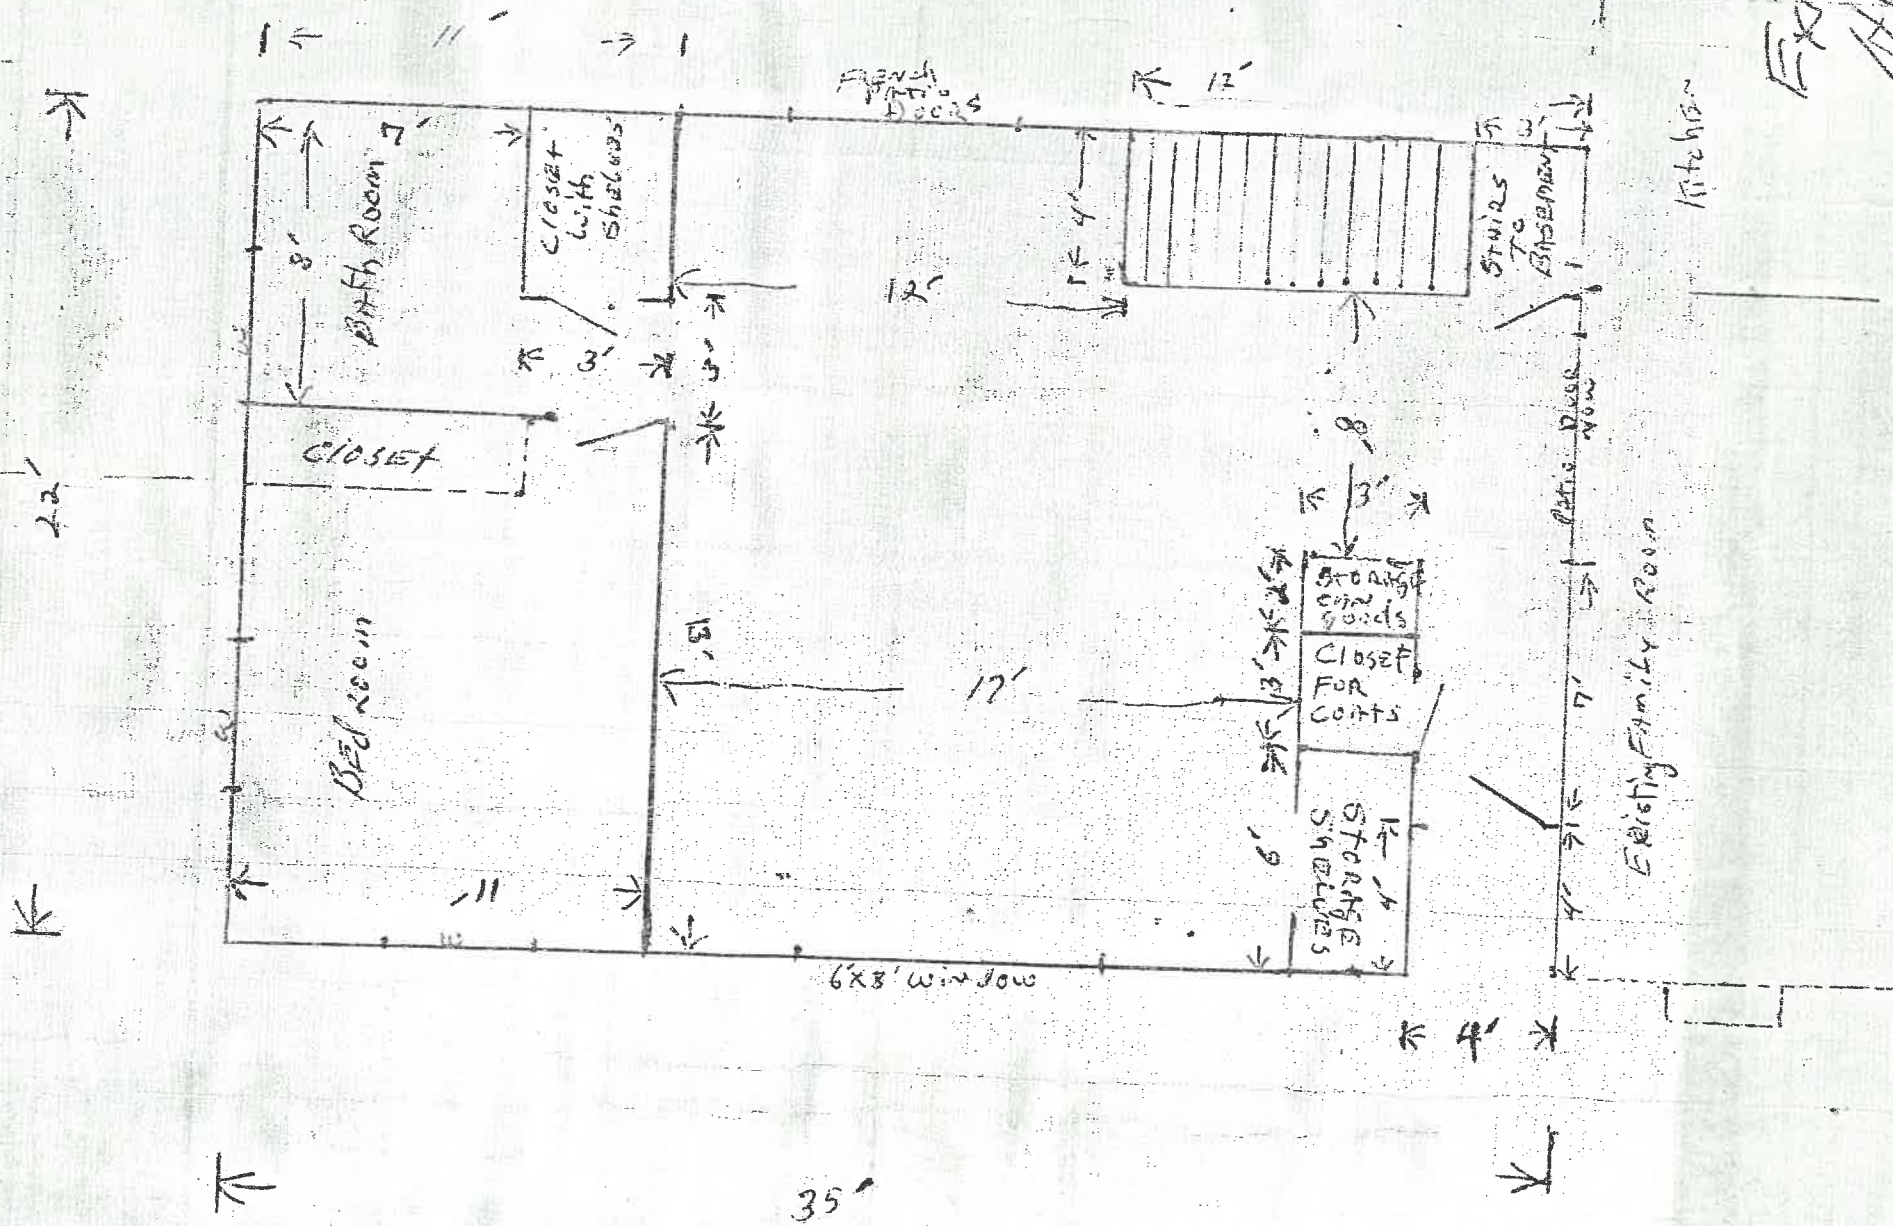

GARY REBEAUX
115 GLENWOOD

10/20/79

- ⊙ ELECTRICALLY SUPPLIED SMOKE DETECTOR
- ⊕ RECEPTACLE
- ⊕ GROUND FAULT CIRCUIT INTERRUPTER RECEPTACLE

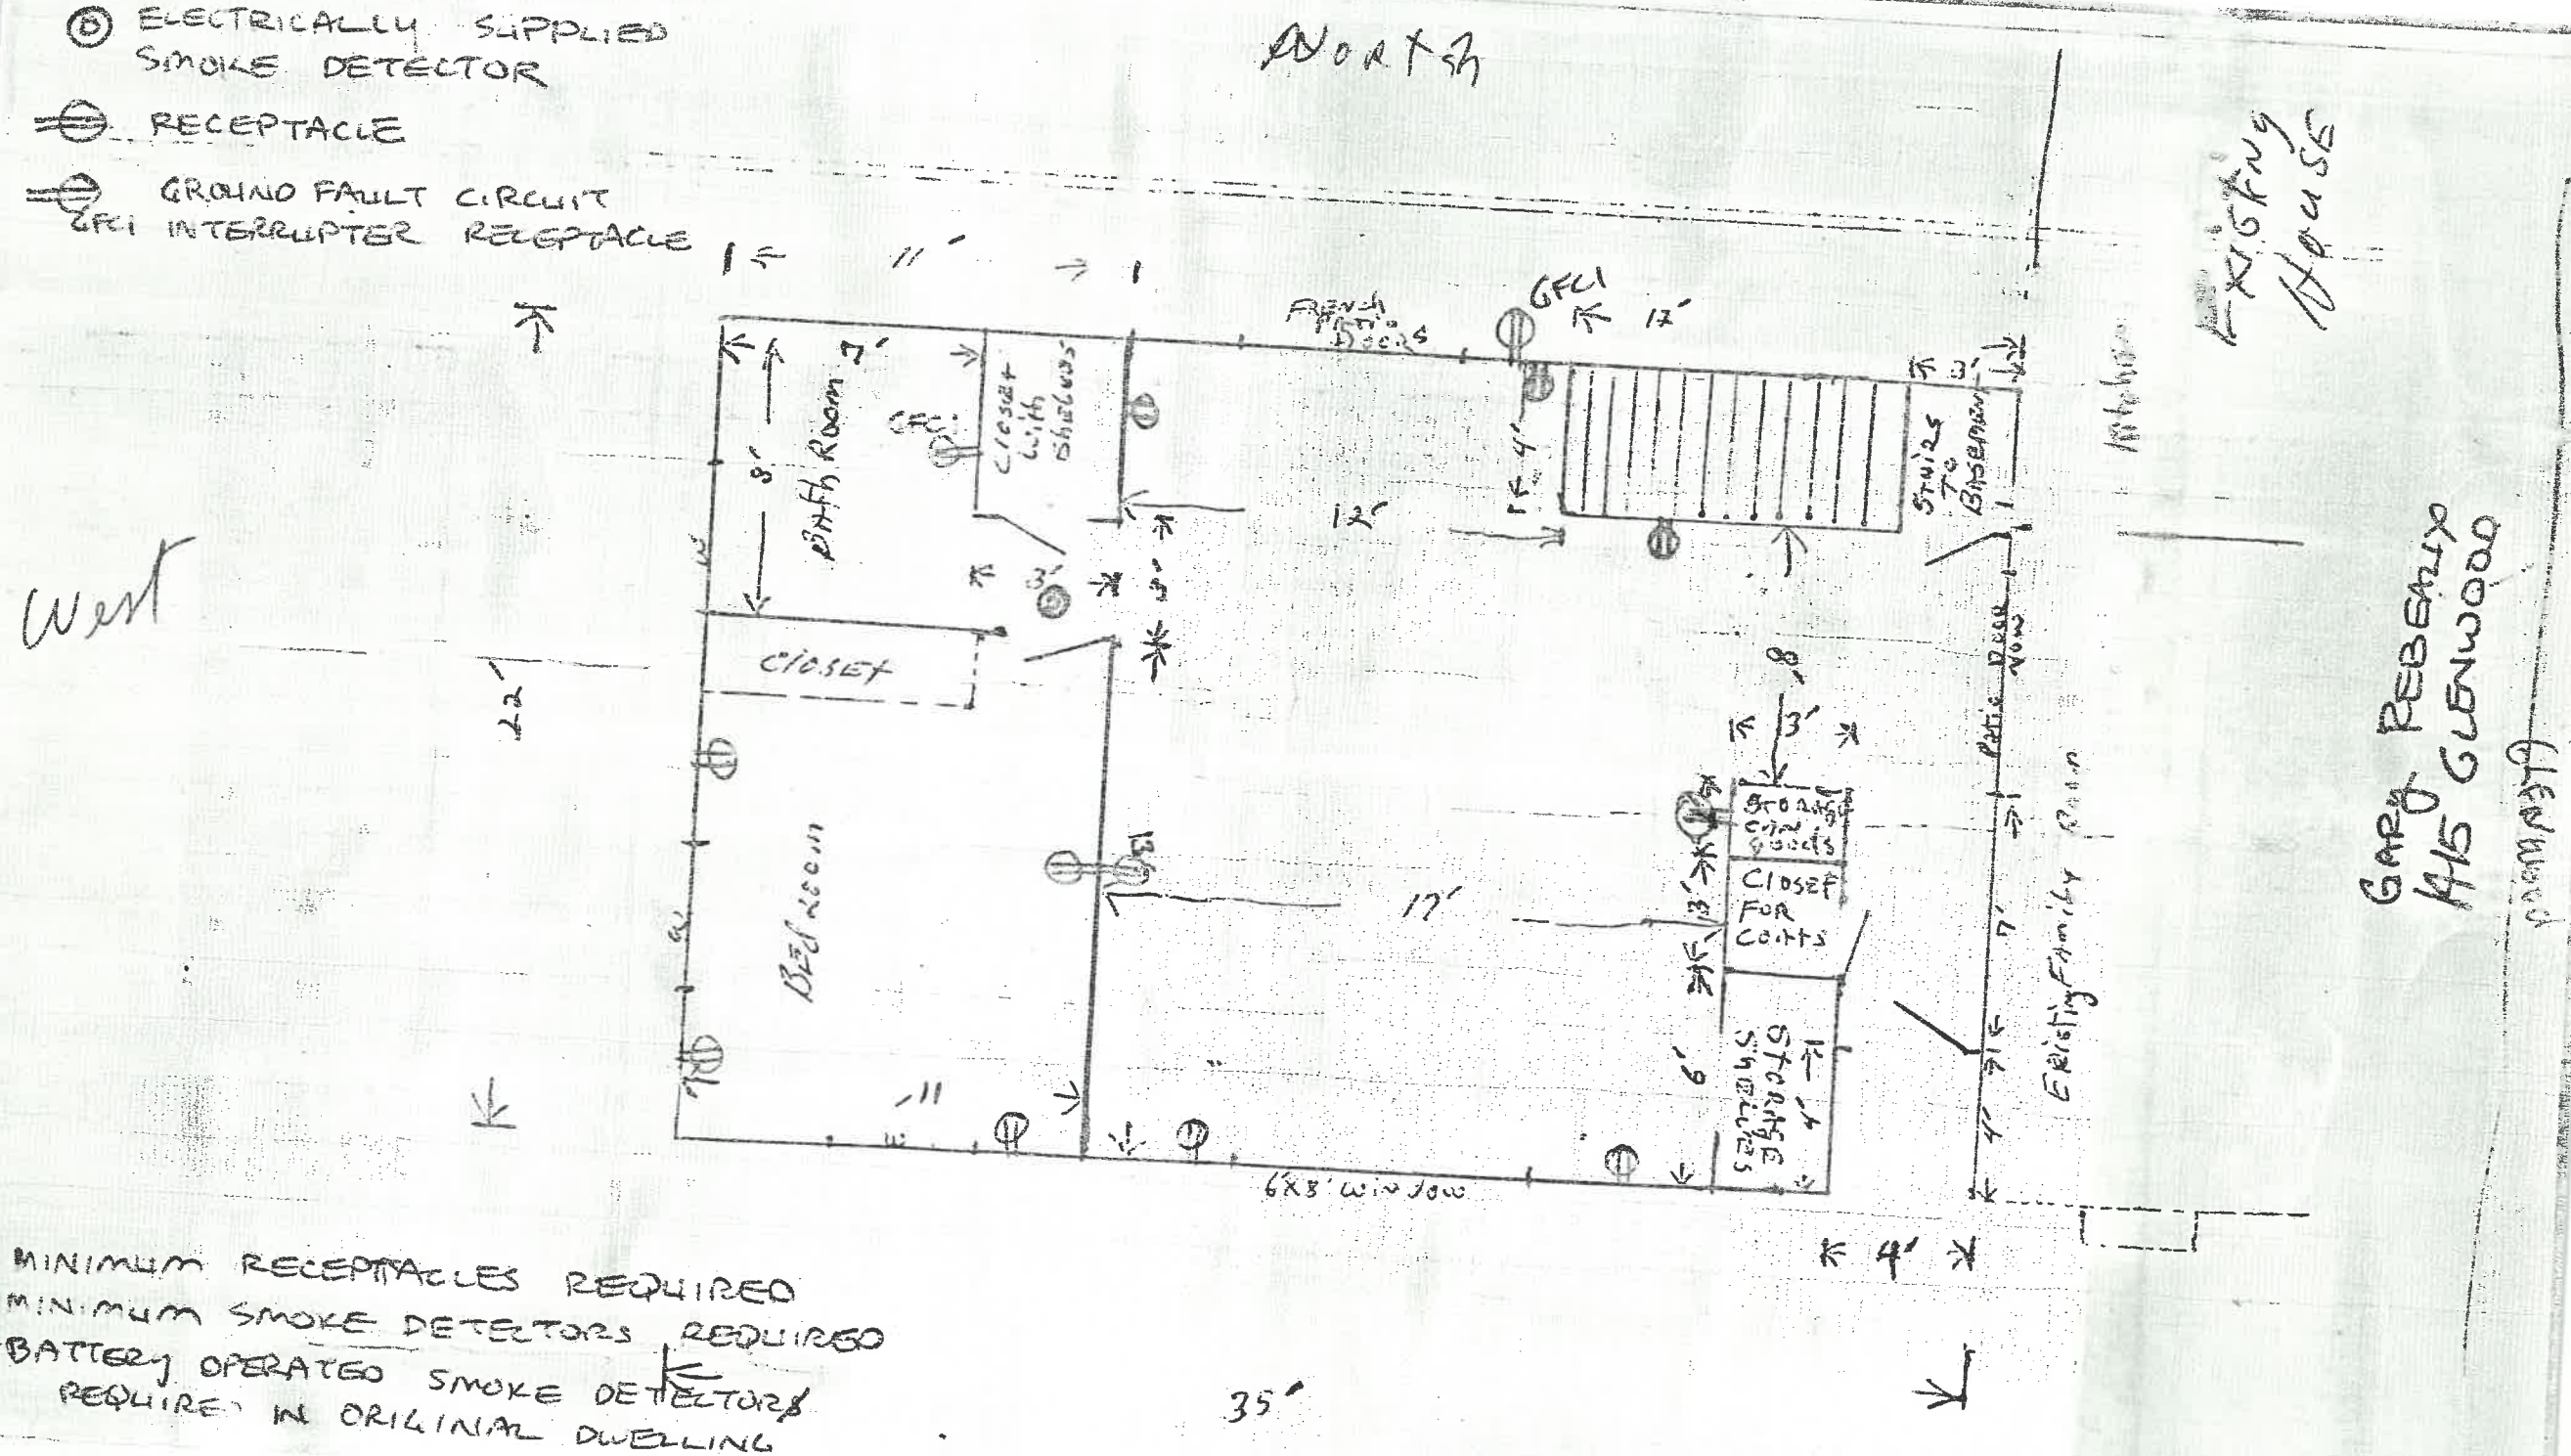

EXISTING HOUSE

GARY REBENIX
 HIS GLENWOOD
 GLENWOOD

MINIMUM RECEPTACLES REQUIRED
 MINIMUM SMOKE DETECTORS REQUIRED
 BATTERY OPERATED SMOKE DETECTORS
 REQUIRED IN ORIGINAL DWELLING

35'