

SEWER TAPPING PERMIT

Issued by

The City of Napoleon Engineering Dept.

255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Entry No. **00410**

Permit No. _____ Issued _____ Build. Permit No. _____

Permit Fee \$ _____

Job Location 940 Lynne Street

Street Bond \$ _____

Lot _____ sub div. or legal disc. _____

Date Paid _____

Issued By _____

Owner ALBERT BELL Pn. _____

Address 940 Lynne Street

Agent Bob Cordes Pn. _____

Address _____

for office use only

WORK INFORMATION

Sanitary Sewer Tap _____ Size of Tap _____ Size and Type of Sewer _____ Street to be Opened _____
yes no

Storm Sewer Tap _____ Size of Tap _____ Size and Type of Sewer _____ Street to be Opened _____
yes no

Street opening Agreement Approval Date _____ Opening Bond Fee (Set by Engineer) _____

READ AND SIGN BELOW; The undersigned hereby agrees complete the work described above and to make use of said sewers only as allowed by and in strict accordance with all applicable provisions of The Napoleon Engineering Dept. Rules and Regulations, The Napoleon Standard Specification for Water Main, Sanitary Sewer and Storm Sewer Construction and other Pertinent Sections of the Napoleon Code of Ordinances.

Date _____ Signature of Applicant _____

Permit not valid without signature

INSPECTION RECORD _____ to be completed by the Field Inspector


Date Inspection is made 5-7-92 Size and Type of Sewer 4" P.V.C. S.D.R.35 - 3034

Location _____ Depth 6 ft Type of Test _____ Additional Information _____

Out let should be replaced, and footer tile not removed

Date 5-7-92 Inspected By Sonny Helberg
signature of Inspector

Sketch Of Installation on Back or Attached

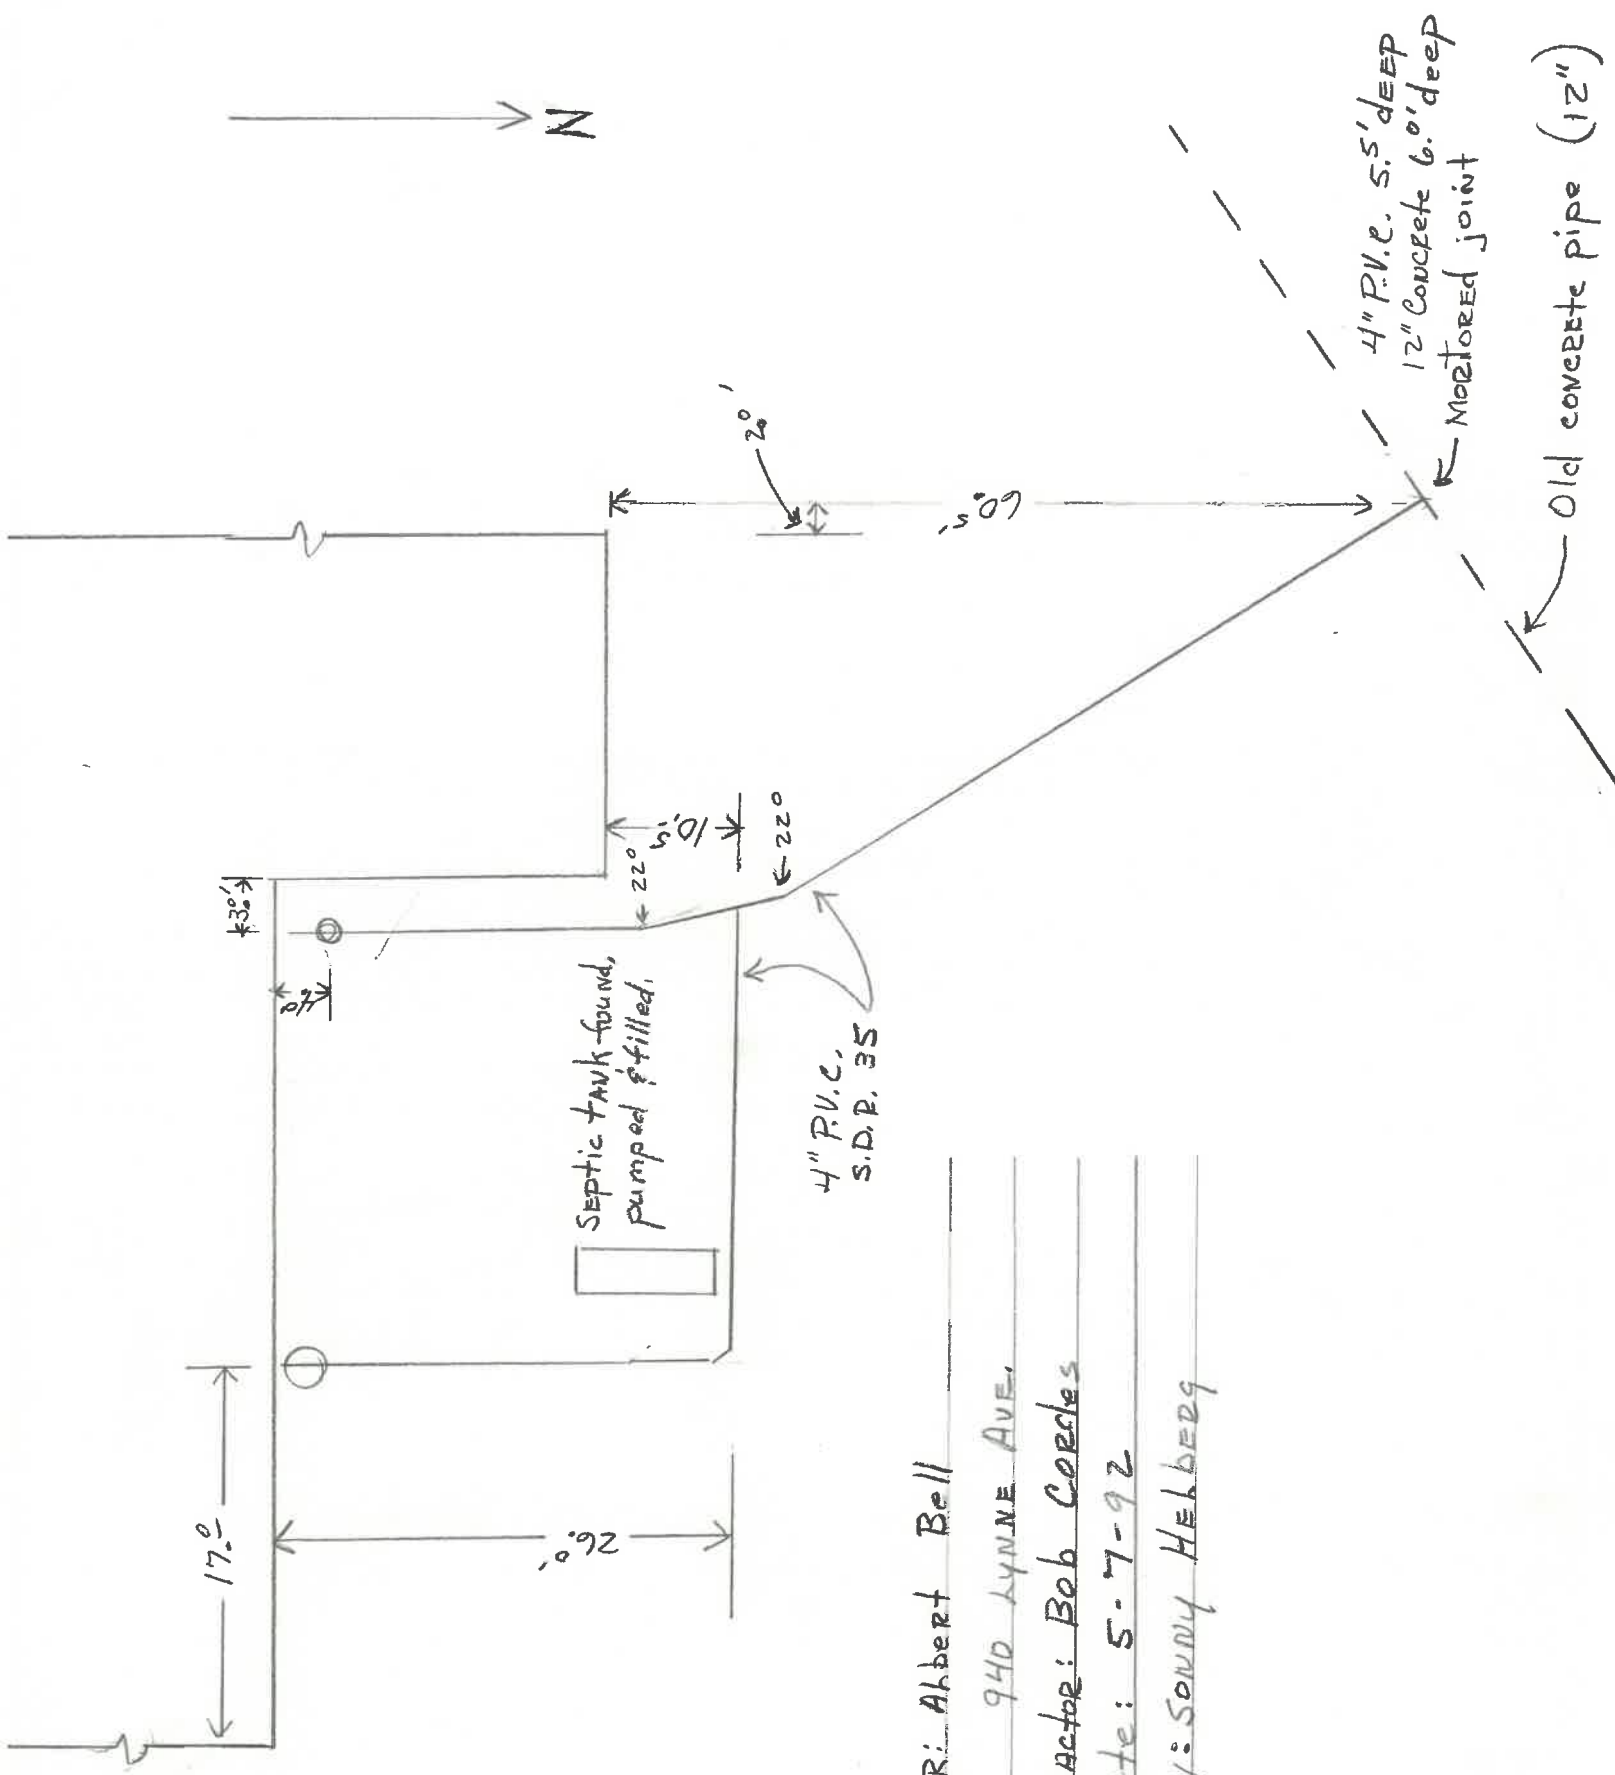

OWNER: Albert Bell
 940 LYNNE AVE.
 CONTRACTOR: Bob Cordes
 DATE: 5-7-92
 BY: Sonny Heberg

4" P.V.C. 5.5' DEEP
 12" Concrete 6.0' DEEP
 MORTARED JOINT
 Old concrete pipe (12")

