

WATER TAPPING PERMIT
 issued by
The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0255 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by Walter E. MacLaughlin
 water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 4-8-96 Street and No. 1360 Sedward

Old Tap No. _____ New Tap No. 9624 Size and Kind of Main 8" C-900

Location of Main 6 1/2' West of West curb Depth of Main 6 1/2'

Distance from Hydrant/Valve 190' South of Hyd #6 Distance to Curb Stop from Corp. 63 1/2'
union coupler 59 1/2'

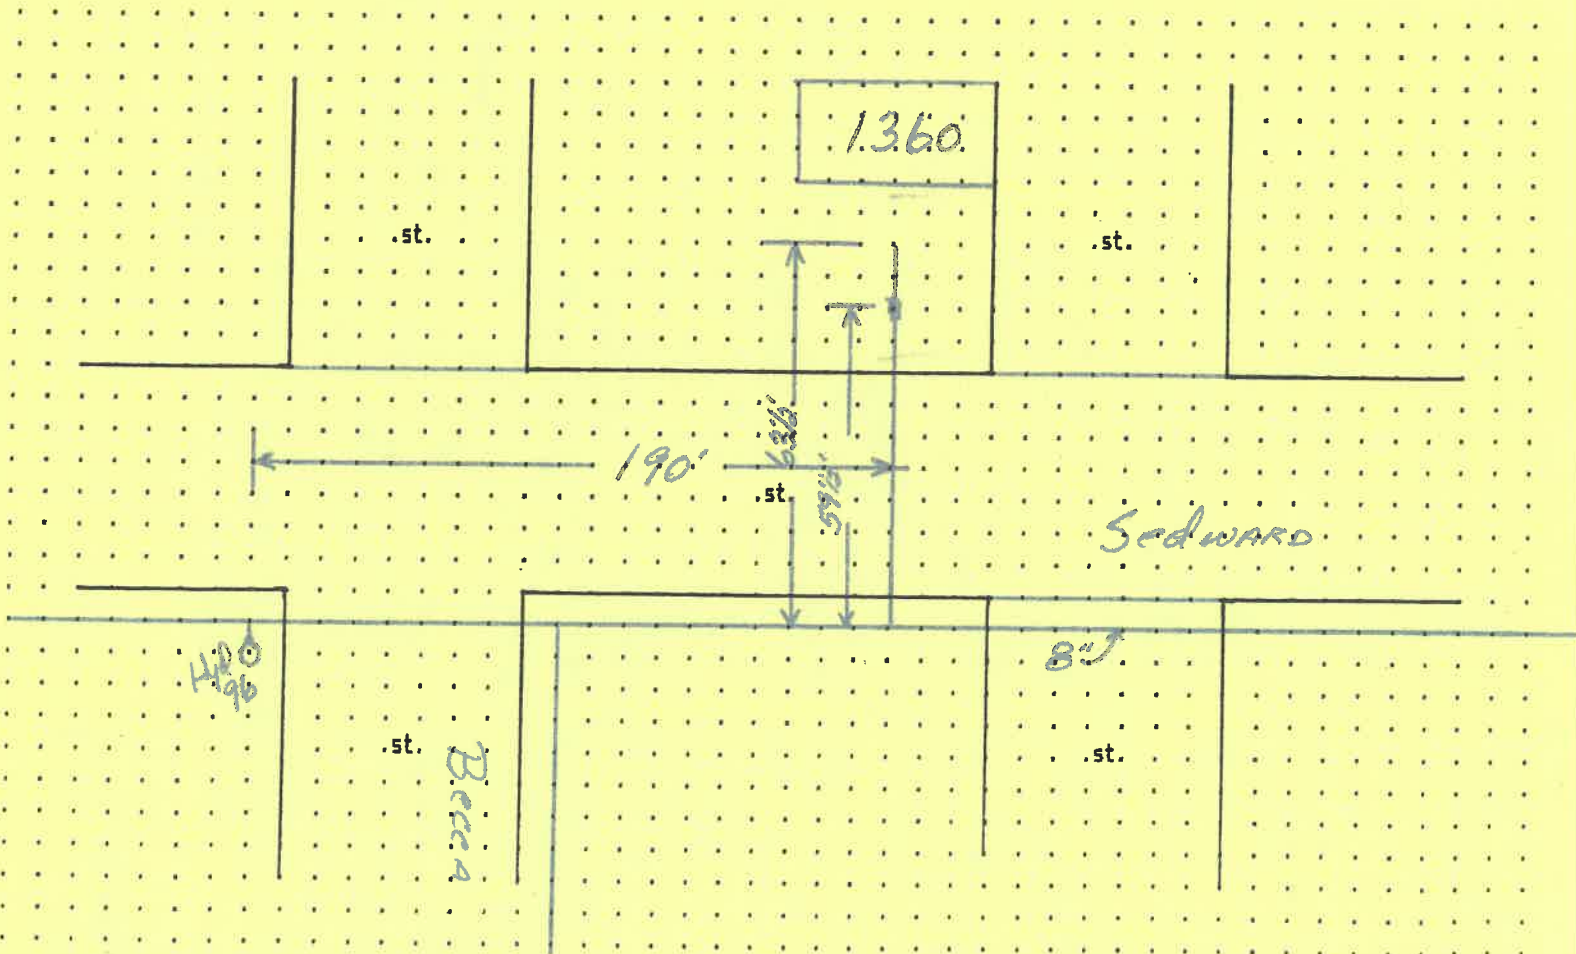

WATER TAPPING PERMIT
 issued by
 The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W-0255 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by W. E. MacHugh
 water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 4-8-96 Street and No. 1360 Sedward

Old Tap No. _____ New Tap No. 9624 Size and Kind of Main 8" C-900

Location of Main 6 1/2' West of West curb Depth of Main 6 1/2'

Distance from Hydrant/Valve 190' South of Hyd #6 Distance to Curb Stop from Corp. 63 1/2'
union coupler 59 1/2'

